Wall Types

Exterior walls 2x6 wood stud Interior walls 2x4 wood stud, unless noted otherwise

Wall Keys

2 2x wood studs on the flat

6 2x6 wood stud wall, 16" oc

Note: 2x4 wood stud wall, 16" oc unless otherwise noted **Key Notes**

A 30" x 22" Minimum Attic Access Panel - Insulated (RO 34" x 26")

Field locate for plumbing or mechanical

Verify size of fixture or appliance

Adjust dimensions to accommodate

Center - Place door or window centered

C Center - on wall

(SD) Smoke Detector (HD) Heat Detector

CO Carbon Monoxide Detector

<u>Dimensions</u>

Dimensions are to face of stud, unless noted otherwise.
 Closets are 24" clear inside, unless dimensioned otherwise.

Square Footages


Sq ft numbers are interior to room for use in calculating finishes.
 Cabinets and fixtures not subtracted.
 Add for doorways when floor finishes run through.

<u>Notes</u>

- Exterior walls 2x6 wood stud @ 16" oc. Provide insulation & vapor barrier conforming to state or local codes. Interior sheathing 1/2" gypsum board. Provide 1/2" exterior rated sheathing, house wrap with drainage plane and siding. Provide step flashing at walls adjacent to roof planes.
- 2. Interior walls 2x4 wood stud @ 16" oc, unless noted otherwise.
- 3. Roof see structural for rafter sizes. Provide 5/8" exterior rated roof sheathing 15# roofing felt, ice & water shield at eaves and valleys, aluminum drip edge and asphalt shingles or metal roofing. Structure not calculated to support slate or tile. Flash all penetrations. Provide cricket at any added chimneys.
- 4. Provide roof and/or ceiling insulation per code. Provide soffit and ridge vents where required for insulation strategy. (Verify with code officer closed cell spray foam or dense-pack cellulose installed at rafters and filling ridge and eaves generally contra-indicates venting, batt insulation always requires venting).
- 5. Provide smoke, carbon monoxide, and heat detectors where shown and where required by code and where required by local authorities.
- 6. Provide fire resistive materials where required by code, including but not limited to, firestopping at penetrations, 5/8" Type X drywall on walls and ceilings to separate garage (where garage present in design) from dwelling, and separation of dwellings (where more than one dwelling present in design), and protection of flammable insulation materials. See Table R302.6 IRC 2015.
- 7. Compliance with code requirements for rooms size and clearances, (hallway widths, room sizes, etc) assume 1/2" drywall on walls and 1/2" drywall on 3/4" strapping on ceilings. Adjust as required if materials differ.
- 8. Shear is only called out where continuous sheathing wood structural panel method will not suffice. See plans for locations where alternate shear methods are required.

General Design Notes

- 1 Builder shall consult and follow the building code and other regulations in effect for the building site for all construction details not shown in these drawings. Requirements described here are specific to this design and/or are provided as reference. Additional building code or local requirements may apply.
- 2 Builder shall maintain a safe worksite, including but not limited to, provision of temporary supports where appropriate and adherence to applicable safety standards.
- 3 Design is based on the snow load listed on the framing plans, 100 mph basic wind speed, Exposure type B, soil bearing capacity of 2000 psf, and Seismic Category C, unless otherwise noted on the framing plans. Builder shall promptly inform Artform Home Plans of differing conditions.

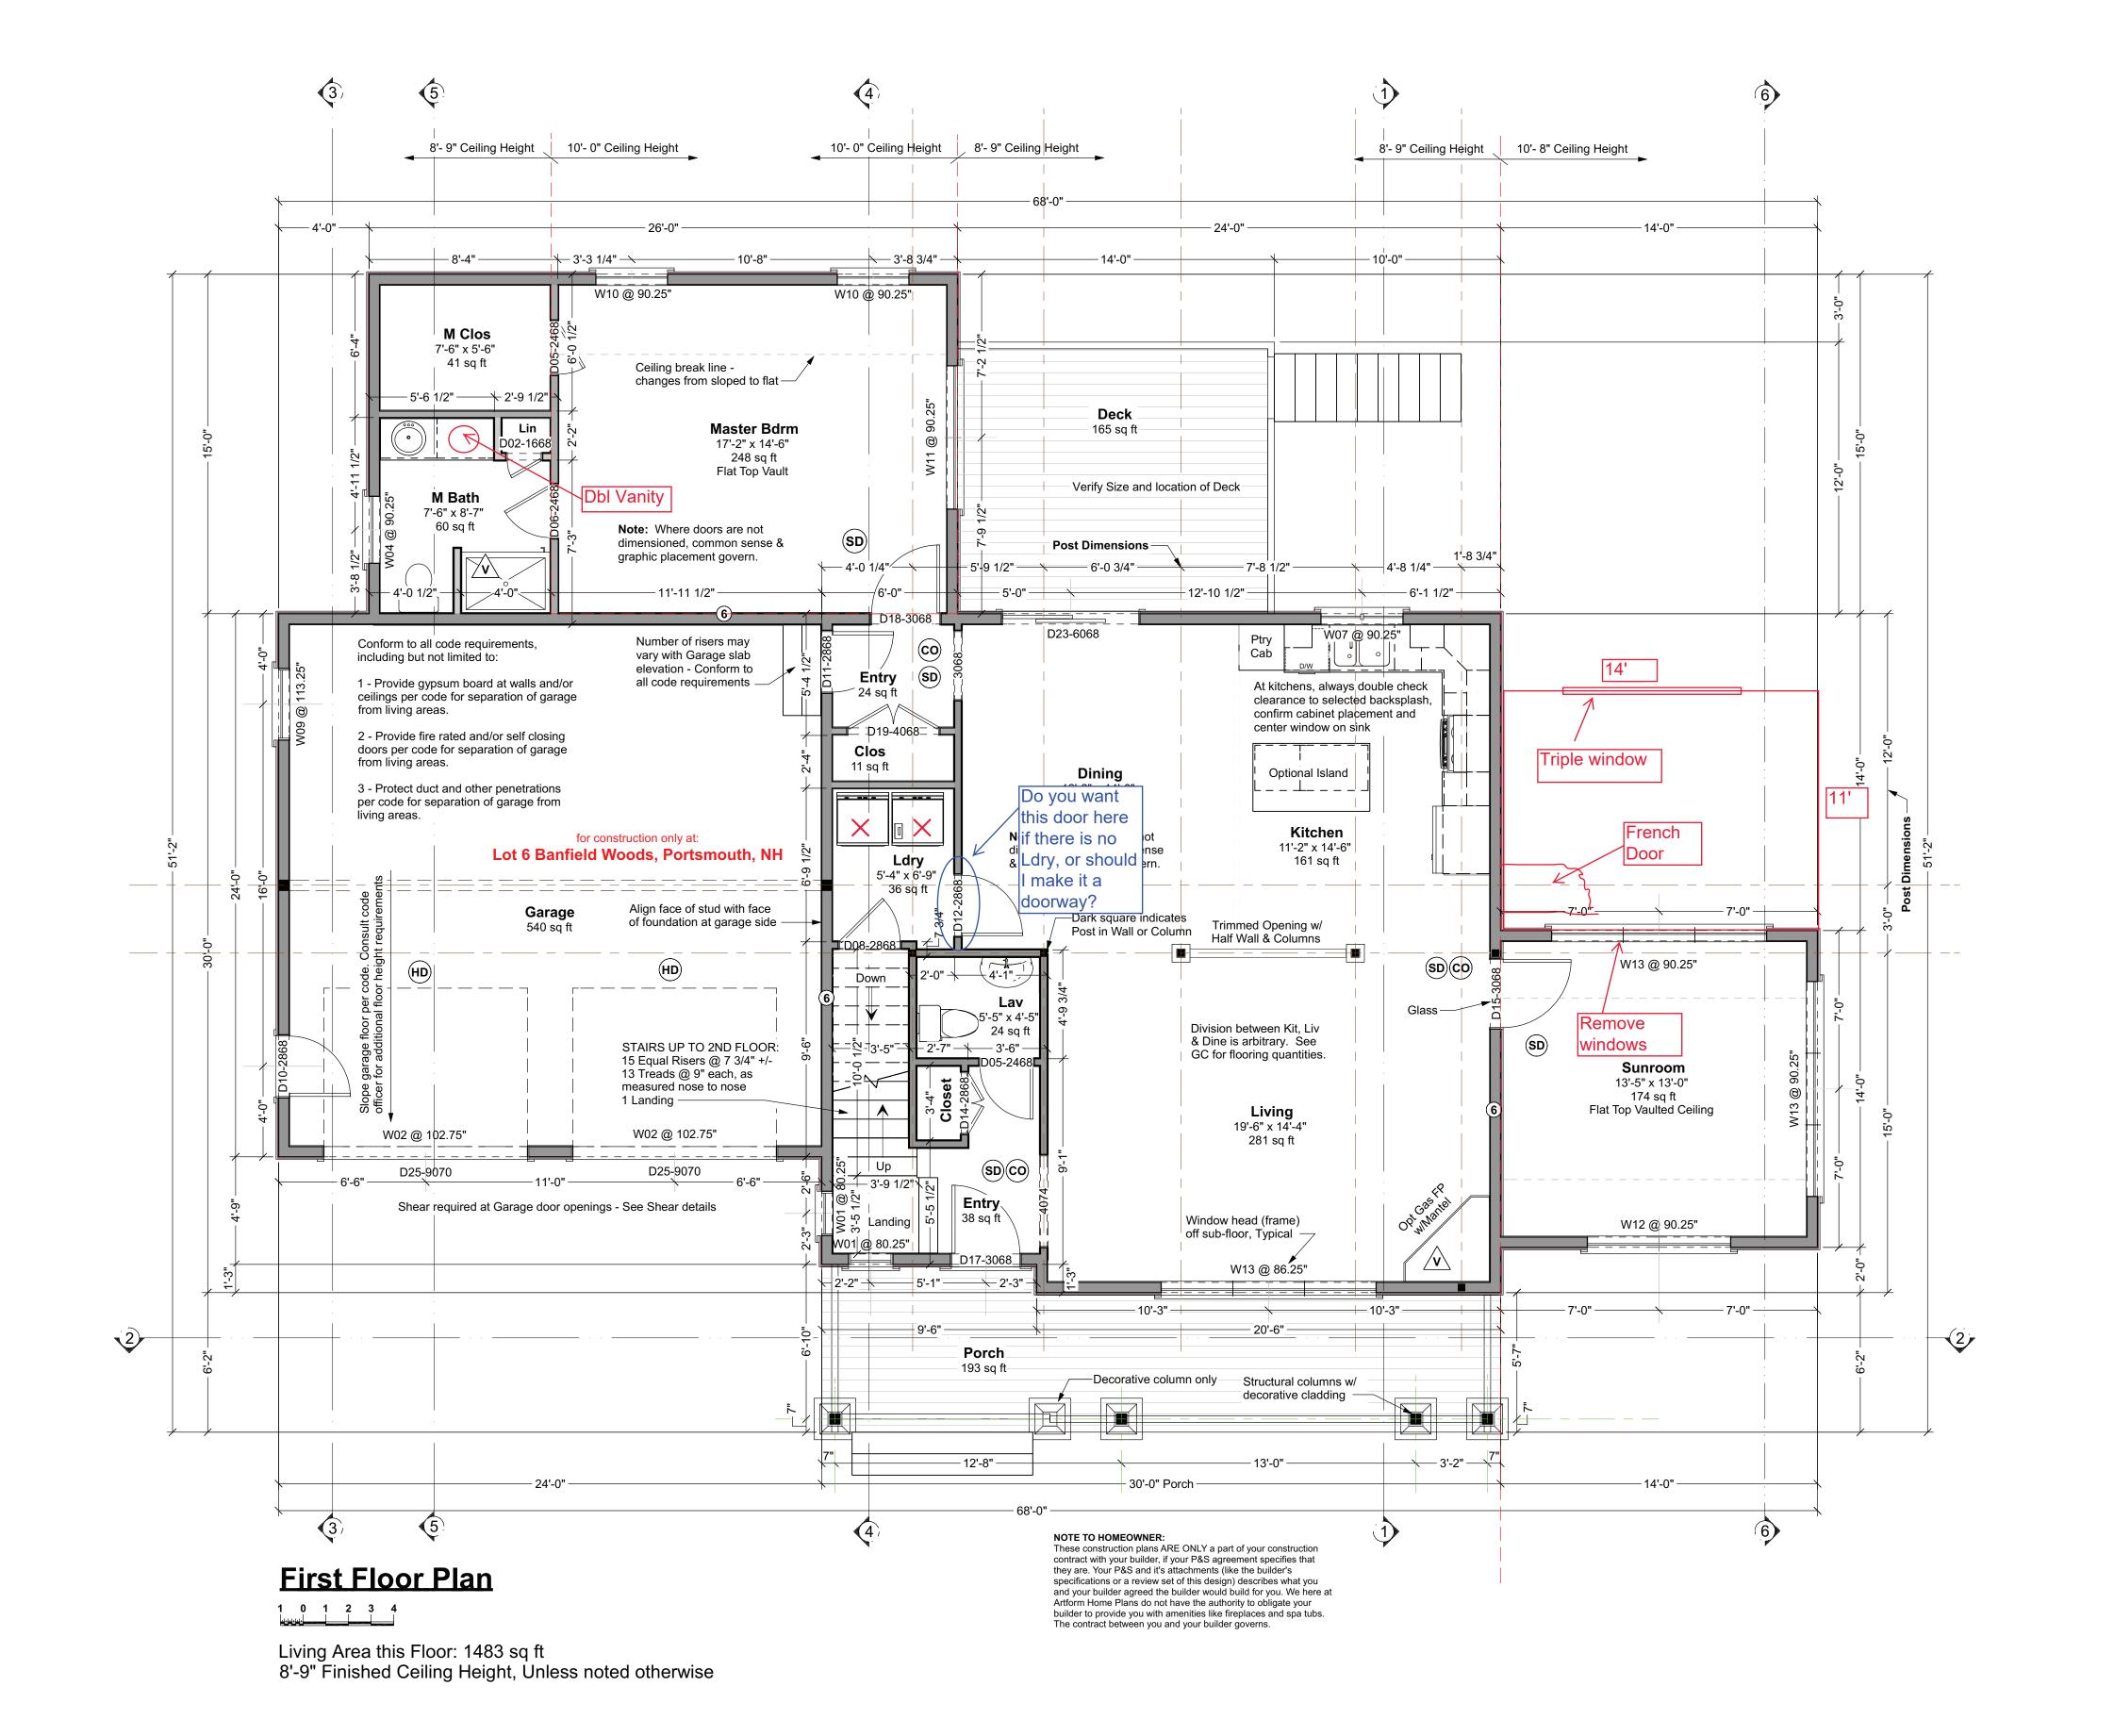

Hennessy Delux



Dear Code Officer.

These are predesigned home plans, designed to bring good design and construction drawings to people at more affordable prices and faster time frames than traditional architecture. Where traditional "internet" home plans disclaim all responsibility, we split responsibility between us (Artform) and the owner. We encourage the future homeowners to use a quality builder who can assist them with this. They are responsible for thermal and moisture decisions and for meeting code in ways that a quality builder should know without an explicit detail. We are responsible for things that are directly related to the design and/or that a quality builder couldn't reasonably figure out on their own - specifically the following IRC 2015 code sections:

1 - Room sizes (Section R304) 2 - Ceiling Height (Section R305)

2 - Ceiling Height (Section R305)
3 - Floor space & ceiling height at Toilet, Bath and Shower Spaces (Section R307)

4 - Hallway widths (Section R311.6)
5 - Door types & sizes (Section R311.2)

6 - Floor space in front of doors (Section R311.3)
7 - Stair width - The stairs in our designs will be a minimum of 36" wide measured wall surface to wall surface, allowing compliance with R311.7.1 with installation of correct handrail.
8 - Stairway headroom (Section R311.7.2)

9 - Stair treads and rise's (Section R311.7.5)
10 - Landings for stairways (Section R311.7.6)
11 - Emergency Escape Window Sizes (Section R310.2.1, R310.2.2, R310.2.3 and R310.2.4). Casement windows may require manufacturer's emergency escape window hardware. Will also

comply with NFPA 101.

12 - Structural Floor Framing (Section R502.3) Where dimensional lumber is shown, framing members will be sized according to this section of the code. Where engineered wood products are shown, those framing members will be size according to the manufacturer's tables for loads and spans, or sizes will have been calculating using manufacturer's published materials properties.

13 - See structural sheets for additional notes.

The builder can and should add information to this set, such as Rescheck, a hand markup of our generic thermal and moisture section, additional information about doors and windows (such as fire rating, tempering, etc), foundation drops relative to site grading, and sometimes their chosen method of basement egress. These drawings are not intended to be used without that additional information.

copyright control only. We have not inspected the site, adapted the design to state specific laws (except where it says so in the drawings) or site or region specific climate conditions. Homeowner and/or Builder shall be responsible for thermal and moisture control strategies, materials choices and compliance with applicable laws and ordinances.

Where a construction address is shown on the drawings, it is for

Please do feel free to call us with any questions. We can and do update our drawings and standard notes to address specific concerns, especially in jurisdictions where our clients will be building

Dear Everybody,

With these drawings a copyright license is granted for a single construction only at Lot 6 Banfield Woods, Portsmouth, NH. This is a License to Build, and does not include a License to Modify, except as required to conform to building code or fulfill builder's/owners responsibilities.

Permissible uses of these drawings: 1. All activities associated with construction at the listed address.

Pricing or preliminary discussions with zoning or code officials for construction at other addresses, with prior notification to Artform Home Plans - just use the Contact form on the web site – http://www.artformhomeplans.com/contact.a5w

Not Permitted: 1. Application for any permits or other approvals for construction at

properties other than the listed address, including but not limited to construction, zoning, conservation, or design review.

2. Modification of the basic design.

Use of these drawings outside these parameters is a violation of federal copyright law, punishable by both civil action and criminal prosecution, as it is stealing or enabling theft of "intellectual property". Making modifications to plans, even significant ones, does not change this, under copyright law, that's considered "derivative works".

We can provide drawings suitable for use in obtaining design or zoning approvals without incurring the expense of a full set of construction drawings. Contact us for more information.

AFHP CD Commons 21.1 X11 - IRC 2015

These drawings are intended for use by an experienced professional builder in responsible charge of the entire project, including but not limited to mechanical, electrical and sitework. Any additional adaptation for these trades or other trades must be determined prior to start of construction. Contact Artform for any adjustments needed.

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/TermsConditions.a5w

If you have any concerns or questions, please feel free to contact us. We are happy to clarify matters that fall within our scope, as listed on the first page. We can also often provide affordable support for issues that are your responsibility, such as energy design/calcs, or additional detailing.



2010-2021 Art Form Architecture 603.43

Hennessy Delux

Lot 6 Banfield Woods

Portsmouth, NH

 Foundations

water or on frozen ground.

least 3000 PSI at 28 days.

braced walls.

ft high or less.

requirements for frost protection.

1. No footing shall be poured on loose or unsuitable soils, in

3. All concrete shall have a minimum compressive strength of at

R403.1.6, it shall consist of minimum size 1/2" diameter anchor

bolts with 3/16" x 2" x 2" washers at a maximum of 72" oc for two stories or 48" oc for more than two stories, max of 12" from

each corner, min of 2 bolts per wall. Anchor bolt shall extend 7"

into concrete or grouted cells of concrete masonry units. Be

officer as a story. Additional anchorage may be required at

with all applicable provisions of IRC 2015 Section 404.1.3.2

aware that a garage under may be counted by your code

5. Foundation reinforcing steel is to be installed in accordance

• 8" poured concrete, 9 ft forms, min 8'-10" finished, with

• (1) #4 rebar @ vertical midpoint. Omit this rebar at walls 4

• Secure sill to foundation with 1/2" diameter anchor bolts that extend 7" into concrete and tightened with a nut and

washer @ 6' oc & max 12" from each corner & each end @ wood sill splices - if built-up sill, bolts must extend through all

1 Use Footing chart(s) below to verify that depth of home matches chart. Depth is foundation dimension eave to eave. Contact Artform Home Plans if you believe the chart

2 Select row for snow load shown on the structural plans. 3 Select a column for soil bearing pressure based on soil

4 The required footing size is at the intersection of the Snow

FAQ - Adding rebar to footings does not reduce the required width. Rebar affects performance with earth movement, like an earthquake and has near zero effect on bearing capacity.

Load and Soil PSF. Rebar is not required. Key or pin

Guide to Soil PSF

sandy silt (CL, ML, MH and CH)

Story and

type of structure

3,000 Sandy gravel and/or gravel (GW and GP)

2,000 Sand, silty sand, clayey sand, silty gravel and

1,500 Clay, sandy clay, silty clay, clayey silt, silt and

8" wall - Footing Size for 28 Ft wide house

2 Story – Plus Basement 23.5 x 7.75 17.25 x 6 12 x 6

2 Story - Plus Basement 24 x 8 17.5 x 6 12 x 6

2 Story - Plus Basement 24.5 x 8.25 17.75 x 6 12 x 6

2 Story - Plus Basement 25.5 x 8.75 19.25 x 6 12.5 x 6

2 Story - Plus Basement 23 x 7.5 17 x 6

2 Story - Plus Basement 25 x 8.5 18 x 6

2 Story - Plus Basement 25 x 8.5 19 x 6

8" wall - Footing Size for 32 Ft wide house

60 PSF 2 Story - Plus Basement 26 x 9 19.5 x 6 13 x 6 2 Story - Plus Basement 26.5 x 9.25 19.75 x 6 13.5 x 6

O PSF 2 Story - Plus Basement 27 x 9.5 20 x 6 14 x 6

8" wall - Footing Size for 36 Ft wide house

type of structure 1500 PSF 2000 PSF 3000 PSF 2 Story – Plus Basement 27 x 9.5 21 x 7 14 x 7 2 Story – Plus Basement 27.5 x 9.75 21.25 x 7 14.5 x 7

2 Story - Plus Basement 28 x 10 21.5 x 7 15 x 7

2 Story – Plus Basement 28.5 x 10.25 21.75 x 7 15.5 x 7 2 Story - Plus Basement 29 x 10.5 22 x 7 16 x 7

type of structure 1500 PSF 2000 PSF 3000 PSF

Load Bearing Value of Soil (PSF)

1500 PSF 2000 PSF 3000 PSF

Load Bearing Value of Soil (PSF)

clayey gravel (SW, SP, SM, SC, GM and GC)

TYPICAL PERIMETER FOUNDATION WALL:

• (1) #4 rebar, min 3" from bottom or per code

sill plates or straps must secure all sill plates.

type and/or consultation with code officer.

foundation wall to footing per code.

TYPICAL PERIMETER FOOTING:

does not match the plan.

• Lap corners & splices of rebar per code.

total of 3 rebar, as follows:

• (1) #4 rebar, 4" from top

4. Foundation anchorage to comply with IRC 2015 Section

2. All exterior footings to conform to all applicable code

Confirmed soil bearing

Checked w/GC for added foundation steps to suit grade

Confirmed garage door size

Confirmed location and installed electrical service grounding - See GC for location

Bulkhead Remove this — 4'-0" ——\ walkout _D24-6068__ _ Basement egress is required, walk-out door −20" Precast Bell or option shown. Builder may relocate walk-out Poured Footing to frost door to suit building site and may substitute with 8" Sonotube, Typ. other code conforming egress, such as window with egress window well or bulkhead. Unfinished Basement 16'-10" x 14'-0" Clos 7'-2' x 14'-0" 236 sq ft [−]6x6 PT Posts shown under Deck & Porch, can be 4x4 PT for posts less 100 sq ft than 48" in height. Consult Artform for Perimeter Footing to frost, 28ft chart decks higher than 8 ft off grade. typical, unless noted otherwise-Verify Size and location of Deck SD(CO) Footing type 36 ft - See Chart Basement egress is required, egress window option shown. Builder may relocate window to suit building for construction only at: site and may substitute other code conforming Lot 6 Banfield Woods, Portsmouth, NH egress, such as walk-out door or bulkhead. Finished Basement 28'-4" x 28'-4" R311.7.1 - Stairways shall not be less than 36" in clear 752 sq ft width at all points above the permitted handrail height and below the required headroom height. Handrails shall not project more than 4.5" on either side of the stairway and the minimum clear width of the stairway at and below the —Post Dimensions handrail height, including treads and landings, shall not be 4'-0 1/4" -- 5'-9 1/2" — 6'-0 3/4" less than 31 1/2" where a handrail is installed on one side and 27" where handrails are provided on both sides. ∠ Line of hang down **Fill Under Garage** Beam Pocket, Typ. -529 sq ft STAIRS UP TO 1ST FLOOR: 5'-5" x 5'-/" 2'-6" x 2'-6" x 1'-0" Footing - 3'-2 1/2" - | 15 Equal Risers @ 7 11/16" +/with (4) #4 E.W. Bott., typical, 13 Treads @ 10" each, as unless noted otherwise measured nose to nose 1 Landing (2) Rebar required in this - Support required. May be footing only, for full width of via built-up post, (single garage face. Use of rebar in masonry RO). Consult GC other footings is optional. -Guards required. GC option Walls or Railings SDCO \1'-6"\ Shear required at Garage door openings - See Shear details Landing
 Verify RO Requirements of Door & Door Location. Confirm location and provide electrical service grounding =໑້⊈Footing type 36 ft - See Chart Footing type 36 ft - See Chart

Foundation Plan

Ceiling Height may vary: 9 ft forms

Finished Living Area this Floor: 1285 sq ft

MINIMUM VERTICAL REINFORCEMENT - BAR SIZE AND SPACING (inches)

NR

6@35

Soil classes and design lateral soil (psf per foot of depth)

GM, GC, SM, SM-SC and ML SC, ML-CL and inorganic CL

6 @ 35

6 @ 32

6 @ 23


Structure designed for Snow Load of 50 psf

MINIMUM VERTICAL REINFORCEMENT FOR 8-INCH (203MM) NOMINAL FLAT CONCRETE BASEMENT WALL

WALL HEIGHT

BACKFILL HEIGHT


Purpose of story pole is to demonstrate compliance with 20 ft exterior maximum and 24" interior minimum. (2) 2x10 Header — Sill Delta - distance from bottom of frame to window opening. Sill Delta Varies from 2¾" to 4" in most brands. Confirm Sill Delta with window manufacturer. Sill Delta, see notes — Dimensions shown apply to typical Double Hung windows. Manually Fin Floor to adjust dimensions where alternate Opening, min 2'-0"— brand/type chosen and/or planned foundation or framing height differ from these drawings. Second Floor First Floor Double Sill Basement Drive/Walk Out

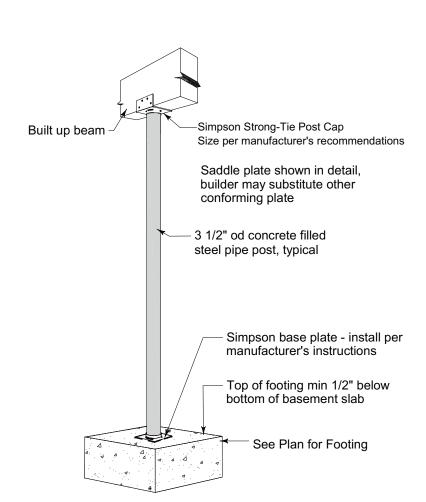

Typical Basement Post

PDF created on: 4/26/2021, drawn by ACJ

R2: 4.22.2021 - 9 ft forms, finish base, sunroom



Beam Pocket

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/TermsConditions.a5w If you have any concerns or questions, please feel free to contact us. We are happy to clarify matters that fall within our scope, as listed on the first page. We can also often provide affordable support for issues that are your responsibility, such as energy design/calcs, or additional detailing. Artform Home Plans AFHP Design # 294.130.v3 GL © 2010-2021 Art Form Architecture 603.431.9559

Hennessy Delux Lot 6 Banfield Woods Portsmouth, NH 1/4"=1'-0" unless noted otherwise / Print @ 1

Foundation Contractor Check List Confirm or review the following prior to forming & pouring foundation

Confirm sill plate thickness (foundation bolts to extend through all)

Checked w/GC for added basement windows

Confirmed sizes and locations of beams w/GC, added or adjusted beam pockets

Checked w/GC for added basement man doors Confirmed sizes & locations mech/plbg penetrations

New foundation under Sun Room - - - - - - - - - - - + - - -Extend foundation 1'-0" to support end of beam **Unfinished Basement** 13'-10" x 12'-8" 174 sq ft SDCO

> Since this is a finished basement, should we keep the 9 FT Forms?