### Wall Types

Exterior walls 2x6 wood stud

Interior walls 2x4 wood stud, unless noted otherwise

### Wall Keys

2

33

(2) 2x wood studs on the flat

(3) 2x3 wood stud wall, 16" oc

(6) 2x6 wood stud wall, 16" oc

Note: 2x4 wood stud wall, 16" oc unless otherwise noted

### Key Notes

A	30" x 22" Minimum Attic Access Panel - Insulated (RO 34" x 26")
F	Field locate for plumbing or mechanical
$\sqrt{\mathbf{v}}$	Verify size of fixture or appliance Adjust dimensions to accommodate
	Snug - Door or Window trim will be snug

 $\overline{S}$  and may need to be cut down Center - Place door or window centered ∕C∖ on wall

Double Stud or structural mull – adapt to suit chosen window brand. / D \ Object is to have some "bite" for curtain hardware and exterior aesthetics.

(SD) Smoke Detector

 $(\mathbf{CO})$ Carbon Monoxide Detector

### Dimensions

Dimensions are to face of stud, unless noted otherwise. Closets are 24" clear inside, unless dimensioned otherwise.

### Square Footages

- Sq ft numbers are interior to room for use in calculating finishes.
- Cabinets and fixtures not subtracted. Add for doorways when floor finishes run through.

### <u>Notes</u>

1 - Exterior walls 2x6 wood stud @ 16" oc. Provide insulation & vapor barrier conforming to state or local codes. Interior sheathing 1/2" gypsum board. Provide 1/2" exterior rated sheathing, house wrap with drainage plane and siding. Provide step flashing at walls adjacent to roof planes.

2 - Interior walls 2x4 wood stud @ 16" oc, unless noted otherwise

3 - Roof - see structural for rafter sizes. Provide 5/8" exterior rated roof sheathing 15# roofing felt, ice & water shield at eaves and valleys, aluminum drip edge and asphalt shingles or metal roofing. Structure not calculated to support slate or tile. Flash all penetrations. Provide cricket at any added chimneys.

4 - Provide roof and/or ceiling insulation per code. Provide soffit and ridge vents where required for insulation strategy. (Verify with code officer - closed cell spray foam or densepack cellulose installed at rafters and filling ridge and eaves generally contra-indicates venting, batt insulation always requires venting).

5 - Provide smoke detectors where shown, where required by code and where required by local authorities.

6 - Provide fire resistive materials where required by code, including but not limited to, firestopping at penetrations, 1/2" drywall on walls and 5/8" drywall on ceilings to separate garage (where garage present in design) from dwelling, and separation of dwellings (where more than one dwelling present in design), and protection of flammable insulation materials.

7 - Confirm bottom of window opening relative to frame. Adjust head heights as required to conform to IRC 2009 R612.2, or provide code approved guards.

8 - Compliance with code requirements for rooms size and clearancess, (hallway widths, room sizes, etc) assume 1/2" drywall on walls and 1/2" drywall on 3/4" strapping on ceilings. Adjust as required if materials differ.


ď

(5)

9 - Some windows must be installed with a head height greater or lesser than the standard 80" or 82 1/2" to provide clearance at kitchen counters, to meet code sill height or to clear roofs. Where approx 84" head height is called for, install 2x10 header tight to double top plate, frame window RO tight to header.

10-Shear is only called out where Continuous Portal Frame will not suffice. See Section R602.10.4 (Pages 173 - 179) of the IRC 2009.

Add 2 ft 3 - 31'-4" -17'-7 1/4" - 2'-1" – W05 @ 86.75\_

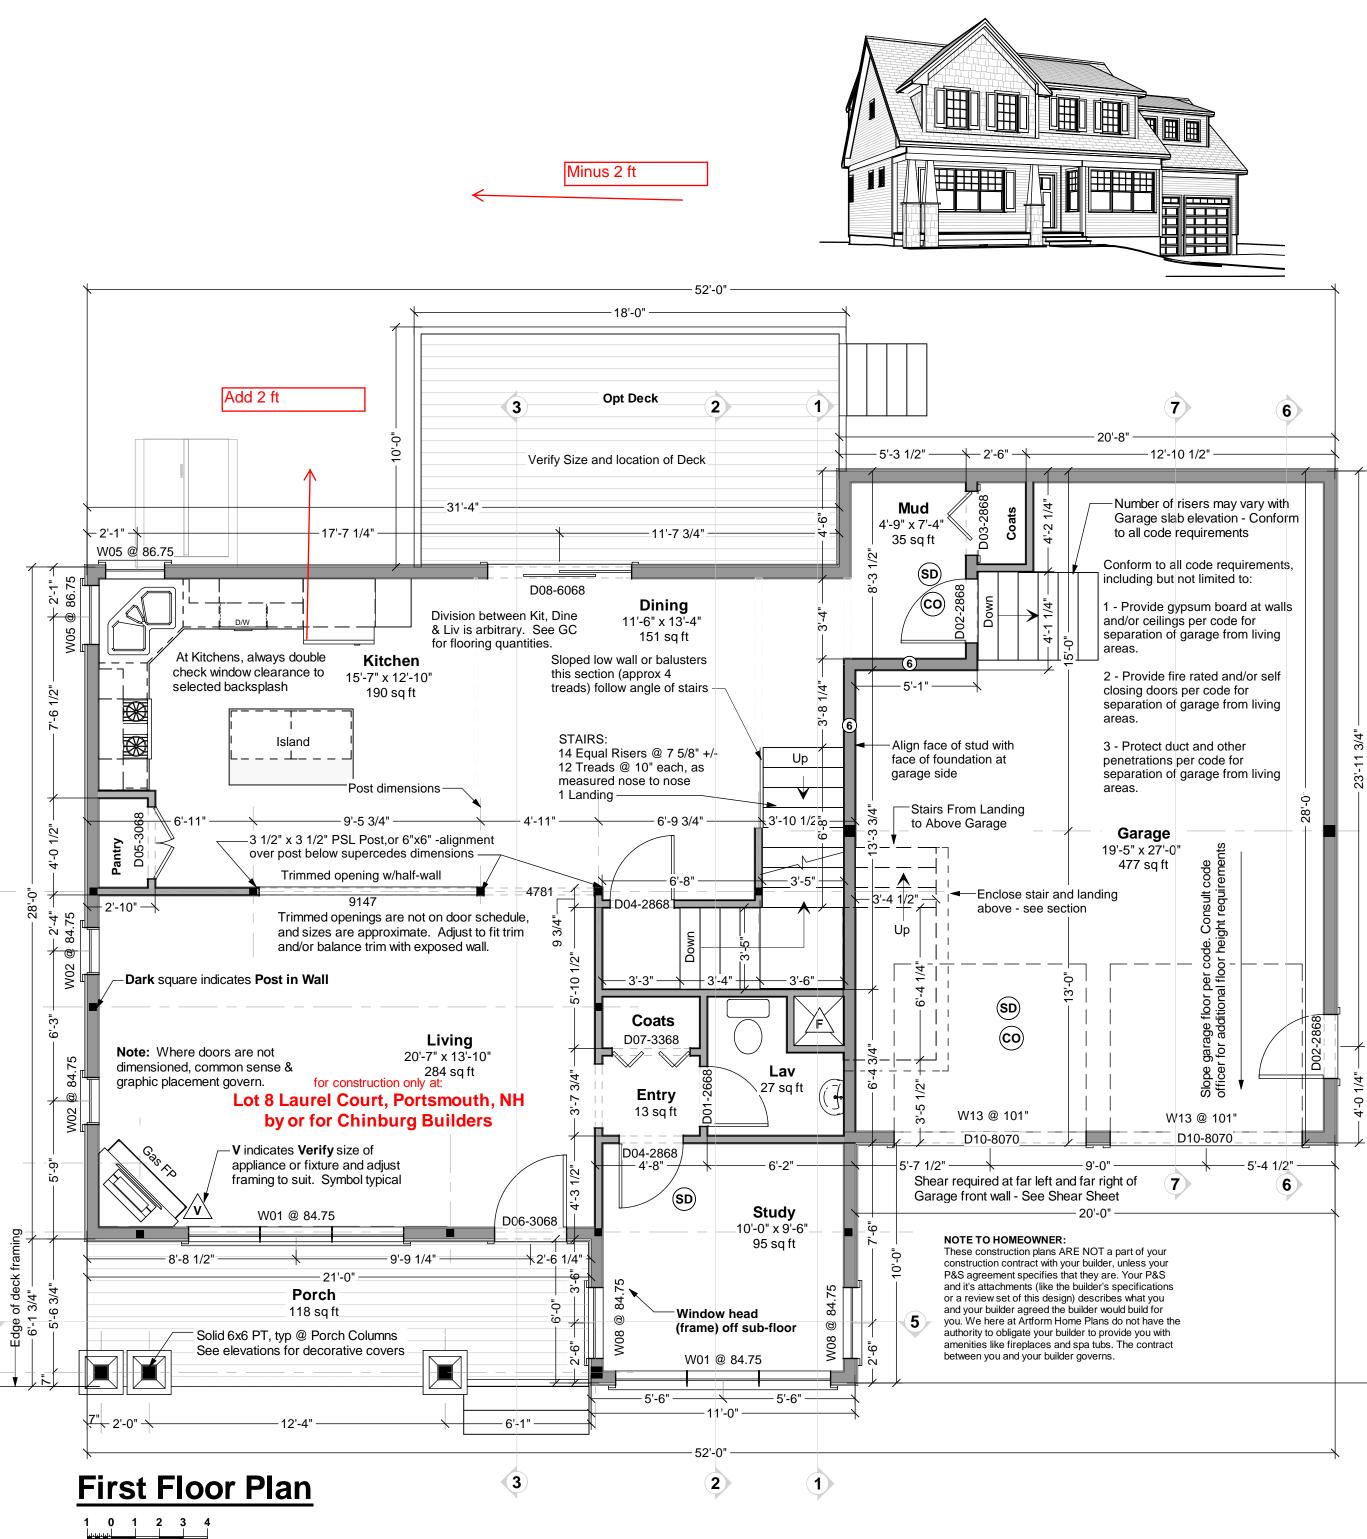

### Dear Code Officer,

These are predesigned home plans, designed to bring good design and construction drawings to people at more affordable prices and faster time frames than traditional architecture. Where traditional "internet" home plans disclaim all responsibility, we split responsibility between us (Artform) and the owner. We encourge the future homeowners to use a quality builder who can assist them with this. They are responsible for thermal and moisture decisions and for meeting coding in ways that a quality builder should know. We are responsible for things that are directly related to the design and/or that a quality builder couldn't reasonably figure out on their own - specifically the following IRC 2009 code sections:

- 1 Room sizes (Section R304)
- 2 Ceiling Height (Section R305)
- 3 Floor space & ceiling height at Toilet, Bath and Shower Spaces (Section R307)
- 4 Hallway widths (Section R311.6)
- 5 Door types & sizes (Section R311.2)
- 6 Floor space in front of doors (Section R311.3) 7 - Stair width - The stairs in our designs will be a minimum of 36" wide measured wall surface to wall surface, allowing compliance with
- R311.7.1 with installation of correct handrail.
- 8 Stairway headroom (Section R311.7.2) 9 - Stair treads and risers (Section R311.7.4)
- 10 Landings for stairways (Section R311.7.5)

11 - Emergency Escape Window Sizes (Section R310.1.1, R310.1.2, R310.1.3 and R310.1.4). Casement windows may require

manufacturer's emergency escape window hardware.

12 - Structural Floor Framing (Section R502.3) Where dimensional lumber is shown, framing members will be sized according to this section of the code. Where engineered wood products are shown, those framing members will be size according to the manufacturer's tables for loads and spans, or sizes will have been calculating using manufacturer's published materials properties. 13 - See structural sheets for additional notes.

The builder can and should add information to this set, such as Rescheck, a hand markup of our generic thermal and moisture section, additional information about doors and windows (such as fire rating, tempering, etc), foundation drops relative to site grading, and sometimes their chosen method of basement egress. These drawings are not intended to be used without that additional information.

Where a construction address is shown on the drawings, it is for copyright control only. We have not inspected the site, adapted the design to state specific laws (except where it says so in the drawings) or site or region specific climate conditions. Homeowner and/or Builder shall be responsible for thermal and moisture control strategies, materials choices and compliance with applicable laws and ordinances.

Please do feel free to call us with any questions. We can and do update our drawings and standard notes to address specific concerns, especially in jurisdictions where our clients will be building again.

### Dear Everybody,

With these drawings a copyright license is granted for a single construction only at Lot 8 Laurel Court, Portsmouth, NH by or for Chinburg Builders. This is a License to Build, and does not include a License to Modify, except as required to conform to building code or fulfill builder's/owners responsibilities.

### Permissable uses of these drawings:

- All activities associated with construction at the listed address. - Pricing or preliminary discussions with zoning or code officials for construction at other addresses, with prior notification to Artform Home Plans - just use the Contact form on the web site http://www.artformhomeplans.com/contact.a5w


<u>Not Permitted:</u> - Application for any permits or other approvals for construction at properties other than the listed address, including but not limited to construction, zoning, conservation, or design review. Modification of the basic design.


Use of these drawings outside these parameters is a violation of federal copyright law, punishable by both civil action and criminal prosecution. It's also stealing or enabling theft, which doesn't suddenly become less bad iust because it's "intellectual property". Making changes, even significant changes, does not change this. Under copyright law, that's "derivative works". You still used our work, and we still spent significant time preparing it, quite possibly in the wee hours when everybody else was sleeping!

We can provide drawings suitable for use in obtaining design or zoning approvals without incurring the expense of a full set of construction drawings. Contact us for more information. We want to allow reasonable use at reasonable costs, just not have our work stolen

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	UTINBURG BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	1
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction



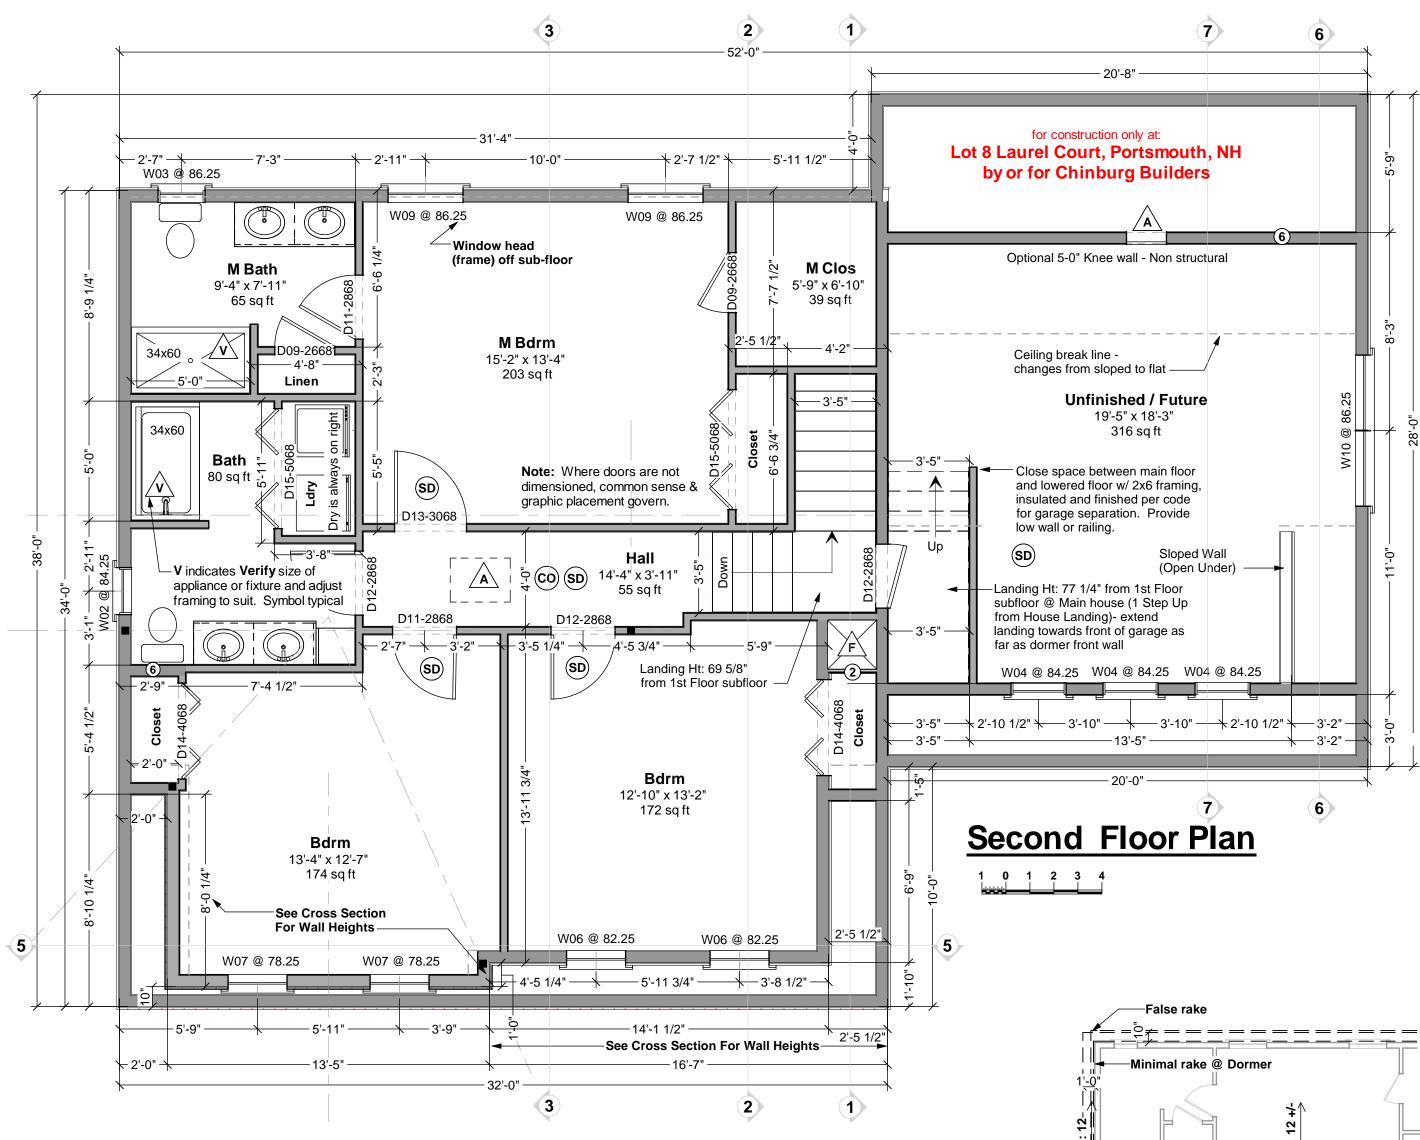


						W	INDOW SCHEDULE			
NUMBER	QTY	WIDTH	HEIGHT	R/O	EGRESS	TEMPERED	TYPE	CODE	MANUFACTURER	COMMENTS
W01			60 1/2 "	108"X61"			MULLED UNIT		PARADIGM	
W02	3	23 1/2 "	23 1/2 "	24"X24"			AWNING		PARADIGM	
W03	1	23 1/2 "	47 1/2 "	24"X48"		YES	DOUBLE HUNG		PARADIGM	
W04	3	27 1/2 "	35 1/2 "	28"X36"			AWNING		PARADIGM	
W05	2	29 1/2 "	41 1/2 "	30"X42"			SNGL CASEMENT		PARADIGM	
W06	2	29 1/2 "	47 1/2 "	30"X48"	YES		SNGL CASEMENT		PARADIGM	
W07	2	29 1/2 "	51 1/2 "	30"X52"	YES		SNGL CASEMENT		PARADIGM	
W08	2	35 1/2 "	59 1/2 "	36"X60"			DOUBLE HUNG		PARADIGM	
W09	2	37 1/2 "	60 1/2 "	38"X61"	YES		DOUBLE HUNG		PARADIGM	
W10	1	75 1/2 "	60 1/2 "	76"X61"	YES		MULLED UNIT		PARADIGM	
W13	2	96 "	12 "	102"X12 1/2"			FIXED GLASS			

DOOR SCHEDULE							
NUMBER	QTY	FLOOR	SIZE	WIDTH	HEIGHT	TYPE	COMMENTS
D01	1	1	2668 R IN	30 "	80 "	HINGED	
D02	2	1	2868 L EX	32 "	80 "	HINGED	
D03	1	1	2868 R EX	32 "	80 "	2 DR. BIFOLD	
D04	2	1	2868 R IN	32 "	80 "	HINGED	
D05	1	1	3068 IN	36 "	80 "	DOUBLE HINGED	
D06	1	1	3068 R EX	36 "	80 "	HINGED	
D07	1	1	3368	39 "	80 "	4 DR. BIFOLD	
D08	1	1	6068 L EX	72 "	80 "	SLIDER	
09ט	2	2	2668 R IN	30 "	80 "	HINGED	
D10	2	1	8070 R	96 "	84 "	GARAGE	
D11	2	2	2868 L IN	32 "	80 "	HINGED	
D12	3	2	2868 R IN	32 "	80 "	HINGED	
D13	1	2	3068 L IN	36 "	80 "	HINGED	
D14	2	2	4068	48 "	80 "	4 DR. BIFOLD	
D15	2	2	5068	60 "	80 "	4 DR. BIFOLD	

### Door & Window Notes

- **1. Rated Doors:** Provide fire rated and/or self-closing doors where required by local codes or local authorities
- 2. Trimmed Openings: Trimmed openings not shown on schedule. See Plan.
- **3. Window Tempering:** Provide tempered windows where required by local codes or local authorities. Tempering column provided here for convenience. Windows have not been reviewed for tempering requirements.
- **4. Window RO's:** 1/4" or 1/2" on each of 4 sides allowed for window RO's, typical. Review framing size vs RO size. Adjust per manufacturer's requirements and/or builder preference.
- **5. Egress Windows:** Provide minimum one door or window meeting egress requirements in basement, in each sleeping room, in each potential sleeping room, and other locations required by local code, in sizes required by local code. Note that casement windows coded by manufacturer as meeting IRC 2006 egress requirements typically need to be ordered with specific hardware.
- 6. Basement Windows: Add basement windows as required to meet state or local code requirements, including but not limited to egress and light/ventilation.
- **7. Skylights:** Skylights are not shown on this schedule, but may be required. Consult builder and/or see floor plan.
- **8. Minimum window sill height:** IRC 2006 and later requires that upper floor window sills be 24" from floor. Where 60" high windows are used, install with window heads @ 84 1/2" or more.

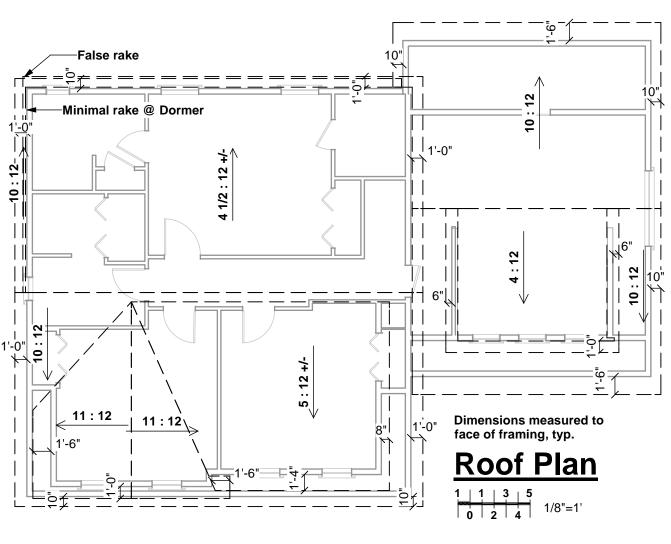

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	BUILDERS
May Tulip Lot 8 Laurel Court Portsmouth, NH	2
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

### Structural General Notes:

1. Builder shall consult and follow the building code and other regulations in effect for the building site for all construction details not shown in these drawings. Requirements described here are specific to this design and/or are provided as reference. Additional building code or local requirements may apply.

2. Builder shall maintain a safe worksite, including but not limited to, provision of temporary supports where appropriate and adherence to applicable safety standards.

3. Design is based on the snow load listed on the framing plans, 90 mph basic wind speed, Exposure type B, soil bearing capacity of 2000 psf, and Seismic Category C, unless otherwise noted on the framing plans. Builder shall promptly inform Artform Home Plans of differing conditions.

### **Foundations**

1. No footing shall be poured on loose or unsuitable soils, in water or on frozen ground.

2. All exterior footings to conform to all applicable code requirements for frost protection.

3. All concrete shall have a minimum compressive strength of at least 3000 PSI at 28 days.

4. Per IRC 2009: Foundation achorage shall consist of minimum size 1/2" diameter anchor bolts with 3/16" x 2" x 2" washers at a maximum of 72" oc for two stories or 48" oc for more than two stories, max of 12" from each corner, min of 2 bolts per wall. Be aware that a garage under may be counted by your code officer as a story. Additional anchorage may be required at braced walls.

### Wood Framing

1. All structural wood shall be identified by a grade mark or certificate of inspection by a recognized inspection agency.

2. Structural wood shall be Spruce-Pine-Fir (SPF) #2 or better.

3. When used, LVL or PSL indicate Laminated Veneer Lumber or Parallel Strand Lumber, respectively. Products used shall equal or exceed the strength properties for the size indicated as manufacturered by TrusJoist.

4. When used, AJS indicates wood I-joists as manufactured by Boise Cascade. Products of alternate manufacturers may be substituted provided they meet or exceed the strength properties for the member specified.

5. All floor joists shall have bridging installed at mid-span or at 8'-0" oc maximum.

6. Floor systems are designed for performance with subfloor glued and screwed.

7. At posts, provide solid framing/blocking to supports below. Provide minimum 1 1/2" bearing length for all beams and headers, unless noted otherwise.

8. All wood permanently exposed to the weather, in contact with concrete or in contact with the ground shall meet code requirements for wood in these environments.

9. Deck ledgers shall be securely attached to the structure and/or independently supported, including against lateral movement, per building code requirements and best practices. Unless otherwise noted, decks shall have solid 4x4 pt posts up to 6 ft above grade, and solid 8x8 for heights above that.

10. Wherever beams are noted as Flush framed, install joist hangers at all joists, sized appropriately for the members being connected.

11. Support the lower end of roof beams via minimum 2" horizontal bearing on a post, ledger or via an appropriately sized and configured hanger.

12. Where multiple beams are supported on one post, provide min 2" bearing for each, via either appropriately sized post cap or additional post(s).

13. Hangers, post caps, ties and other connectors shall be as manufactured by Simpson Strong Tie, as designed to connect the members shown, and shall be installed per manufacturer's instructions.

Prefabricated Wood Trusses

1. Where trusses are indicated on the drawings, truss design shall be provided by truss manufacturer.

2. Trusses shall be designed in accordance with applicable provisions of the latest edition of the National Design Specifications for Wood Construction (NDS), American Forst and Paper Association (APA), and Design Specifications for Metal Plate Connected Wood Trusses (ANSI/TPI 1), Truss Plate Institute (TPI) and code of jurisdiction.

3. Manufacturer shall furnish design drawings bearing seal and registration number of a structural engineer licensed in the state where project will be built.


### **TYPICAL PERIMETER FOUNDATION WALL:**


- 8" poured concrete, 8 ft forms, min 7'-10" finished, with total of 3 rebar, as follows:
- (1) #4 rebar, 4" from top
- (1) #4 rebar @ vertical midpoint. Omit this rebar at walls 4 ft high or less.
- (1) #4 rebar, min 3" from bottom or per code
- Lap corners & splices of rebar per code.
- Secure sill to foundation with 1/2" diameter anchor bolts that extend 7" into concrete and tightened with a nut and washer @ 6' oc & max 12" from each corner & each end @ wood sill splices - if built-up sill, bolts must extend through all sill plates or straps must secure all sill plates.

### **TYPICAL PERIMETER FOOTING:**

- 1. Verify that depth of home matches chart. Depth is foundation dimension eave to eave. Contact Artform Home Plans if you believe the chart does not match the plan.
- 2. Select column for snow load shown on the structural plans. 3. Select soil bearing pressure based on soil type and/or
- consultation with code officer.
- 4. The required footing size is at the intersection of the Snow Load and Soil PSI. Rebar is not required. Key or pin foundation wall to footing per code. For the purposes of permitting, soil bearing for New England is assumed to be 2,000 PSI.

FAQ - Adding rebar to footings does not reduce the required width. Rebar affects performance with earth movement, like an earthquake and has near zero effect on bearing capacity.

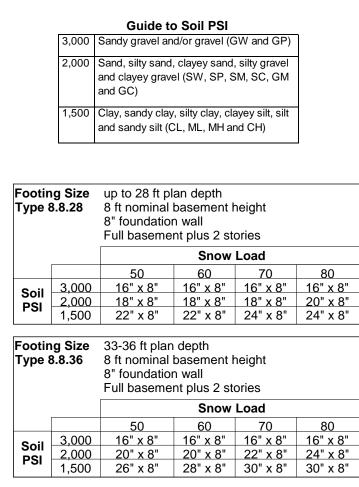

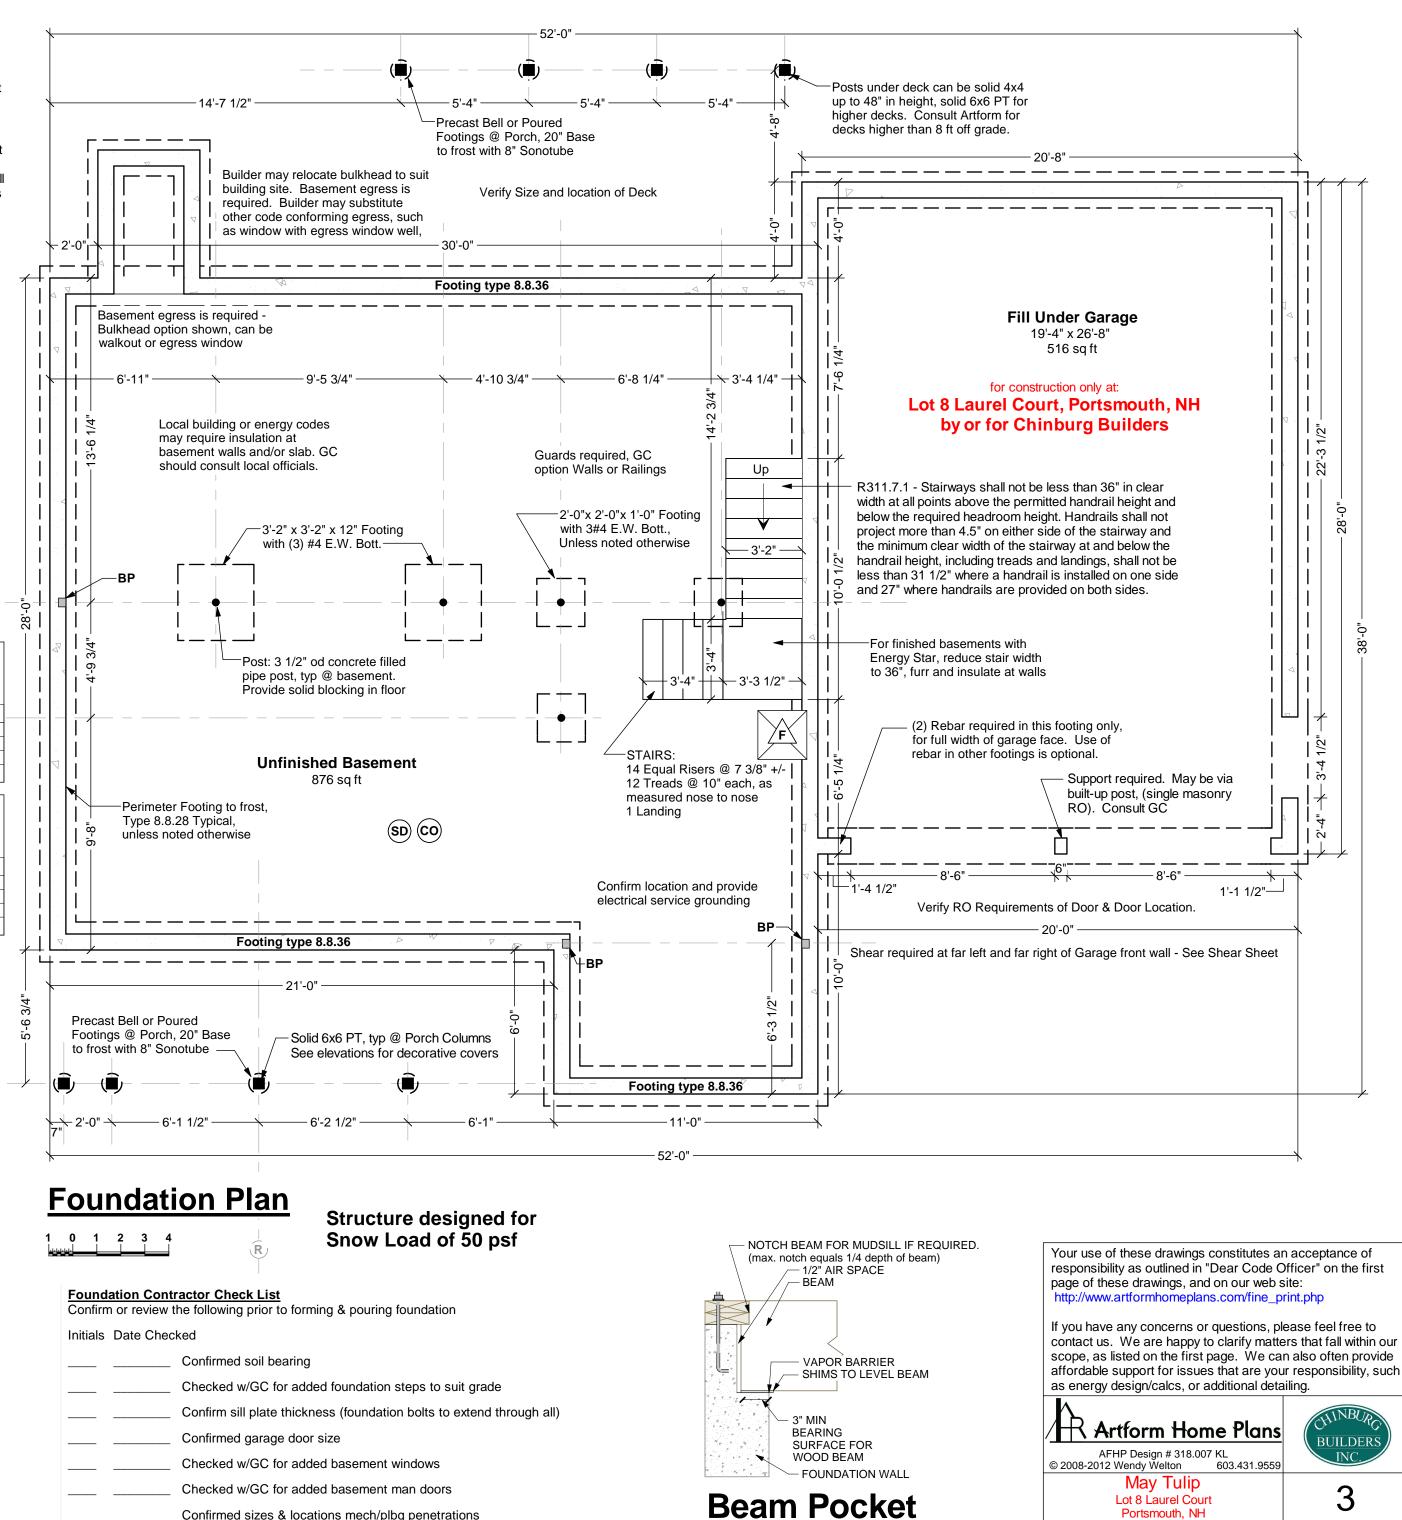

Scale 1/2"=1'-0"


 Confirmed soil bearing
 Checked w/GC for added four
 Confirm sill plate thickness (for
 Confirmed garage door size
 Checked w/GC for added bas
 Checked w/GC for added bas
 Confirmed sizes & locations n
 Confirmed sizes and locations

mech/plbg penetrations


s of beams w/GC, added or adjusted beam pockets

affordable support for issues that are your responsibility, such

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	CHINBURC BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	3
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

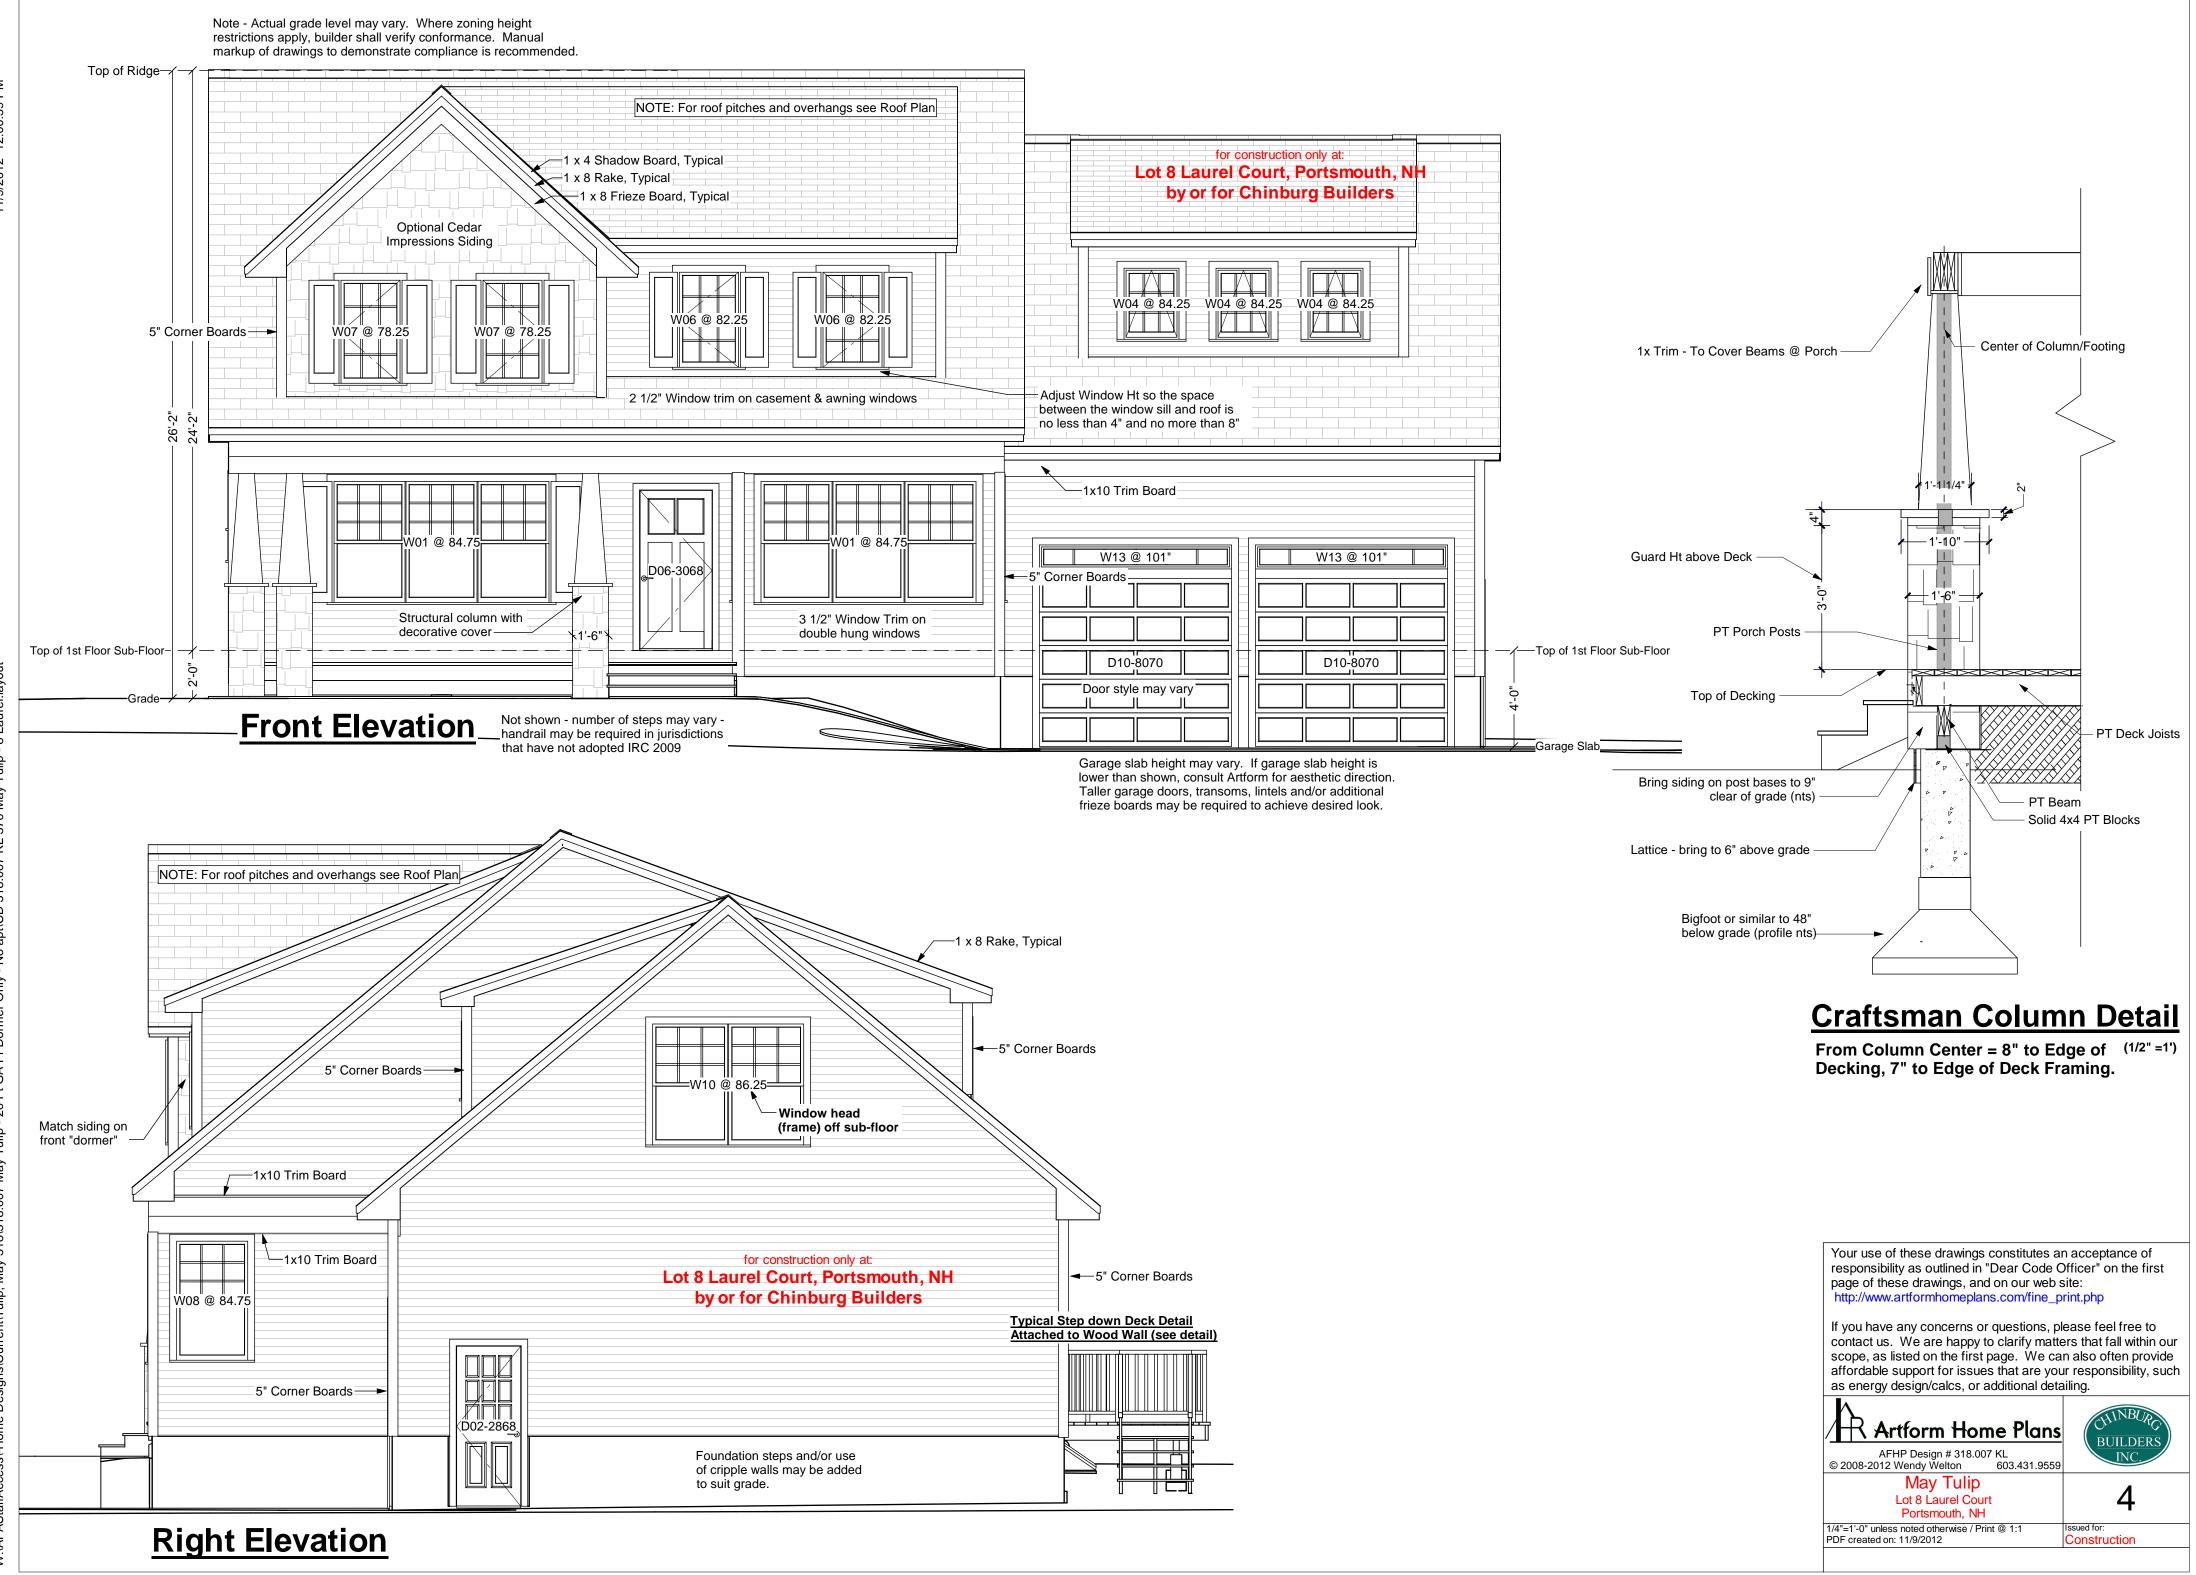

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	CHINBURG BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	4
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

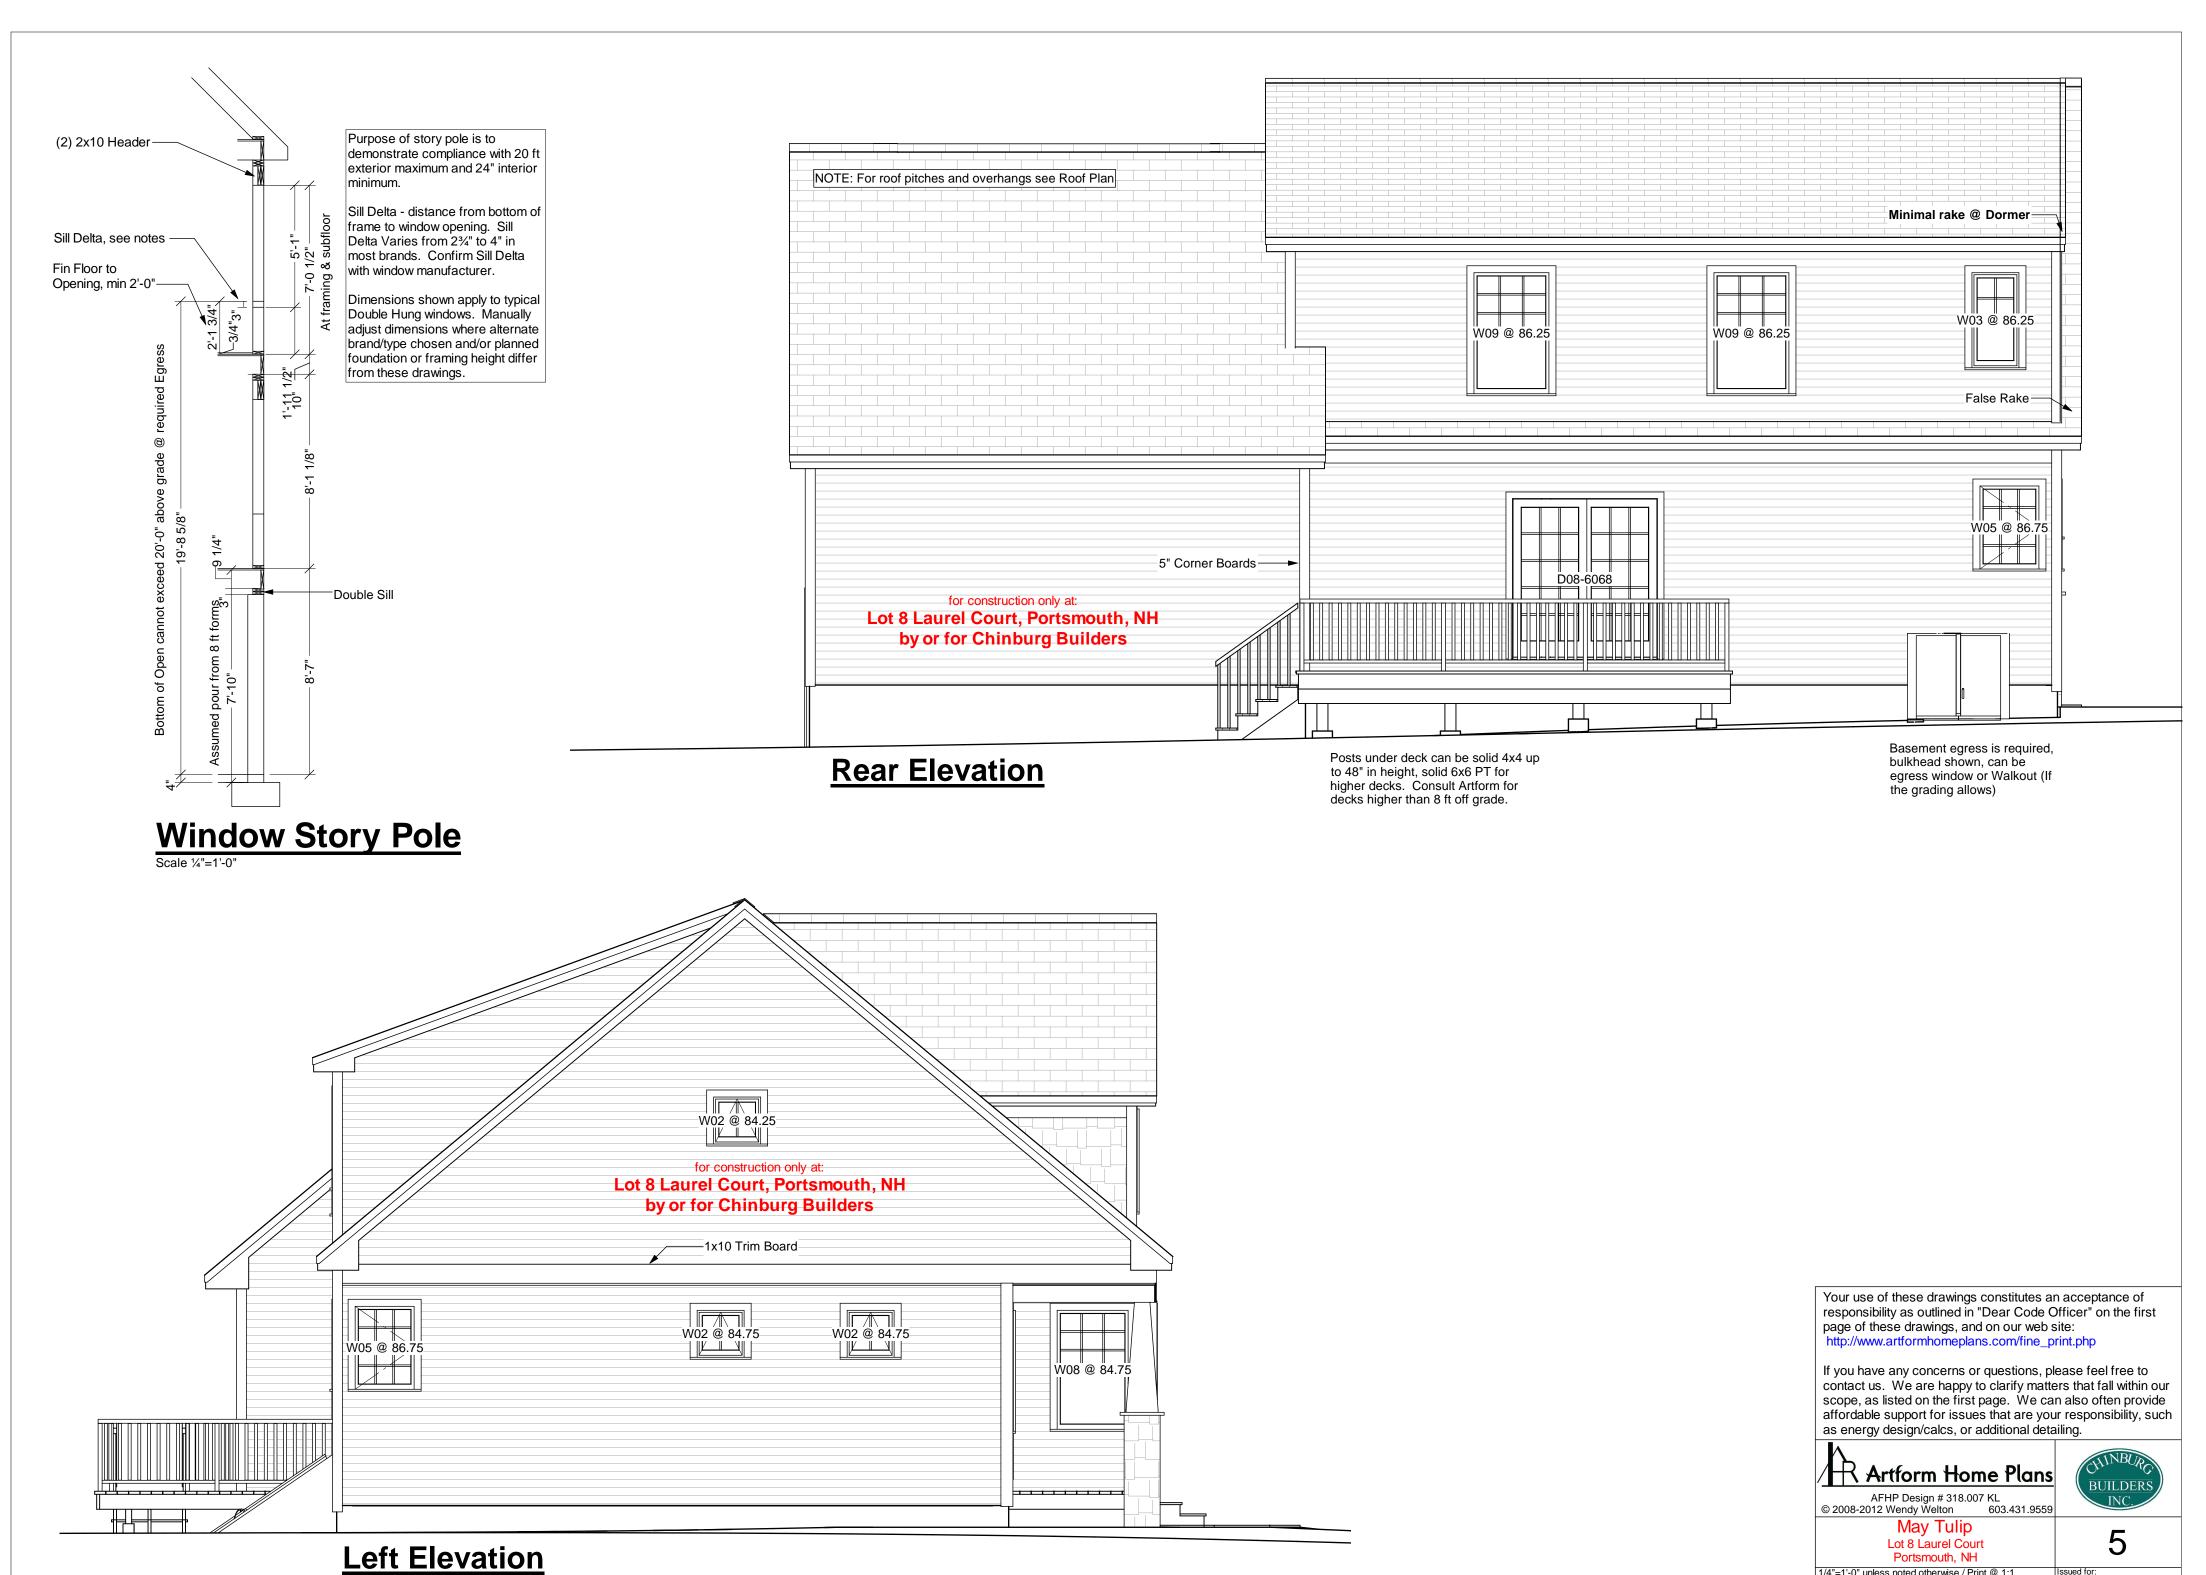

1/4"=1'-0" unless noted otherwise / Print @ 1:1


PDF created on: 11/9/2012

sued for:

Construction


11/9/2012 12:00:59 PM


Š

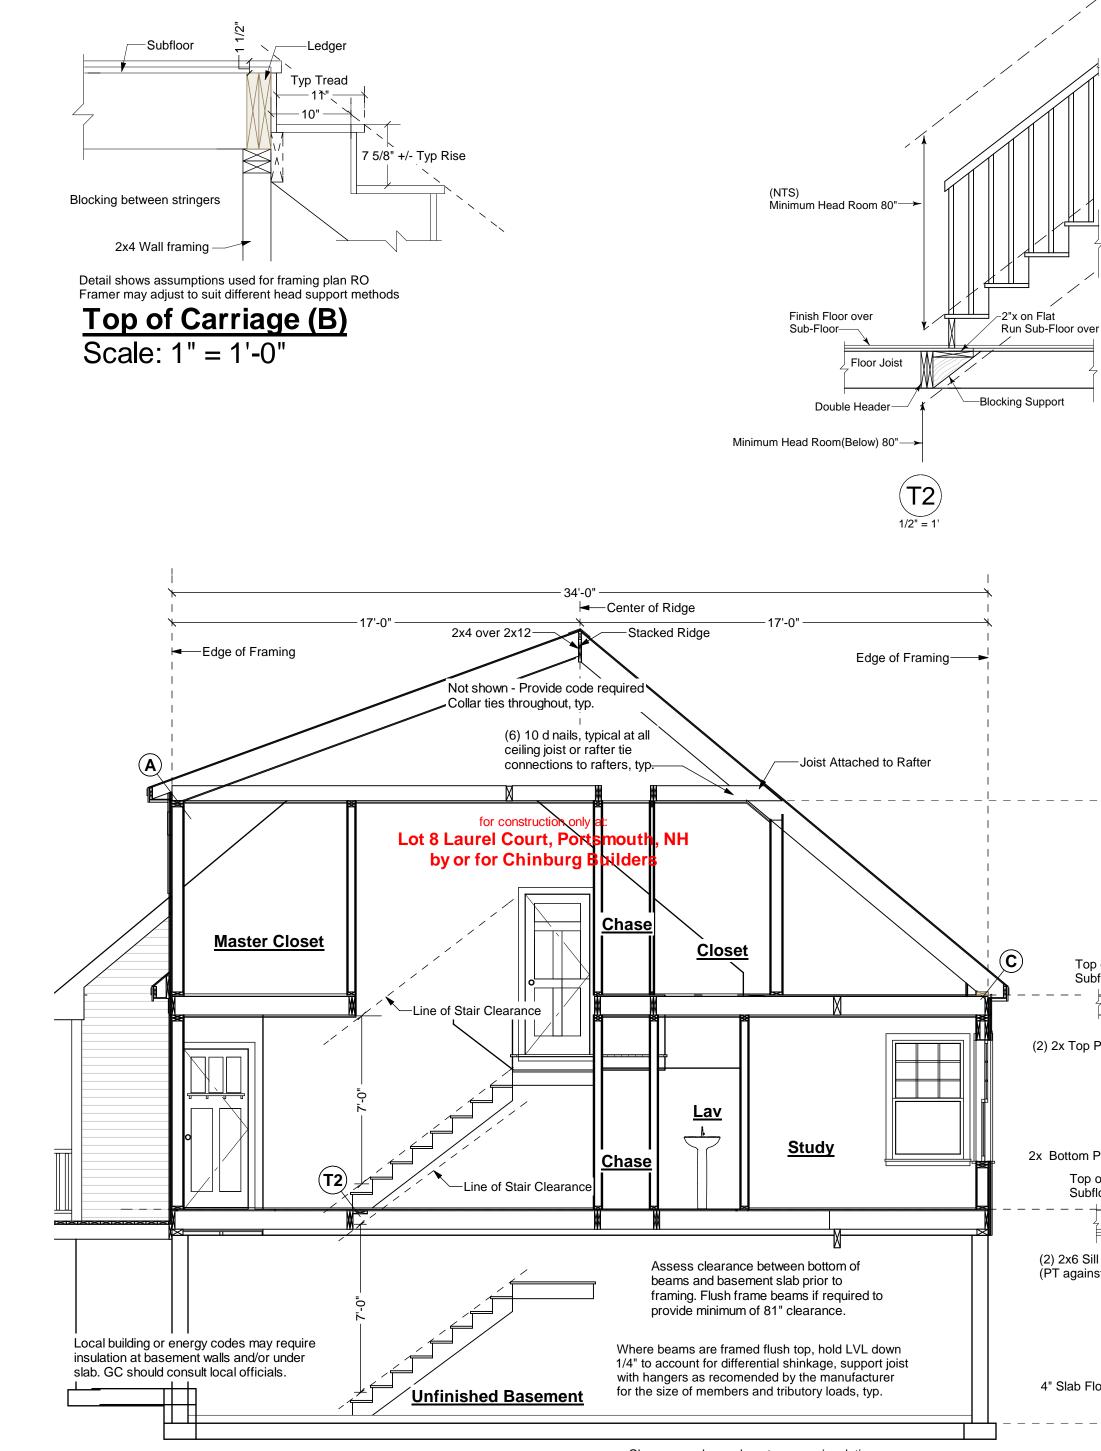



**1 Cross Section @ Stairs** 


Clearances shown do not assume insulation under the basement slab. If that insulation is added to meet local energy codes, adjust stairs as needed, see Detail T2 for framing adjustment to gain addition headroom.

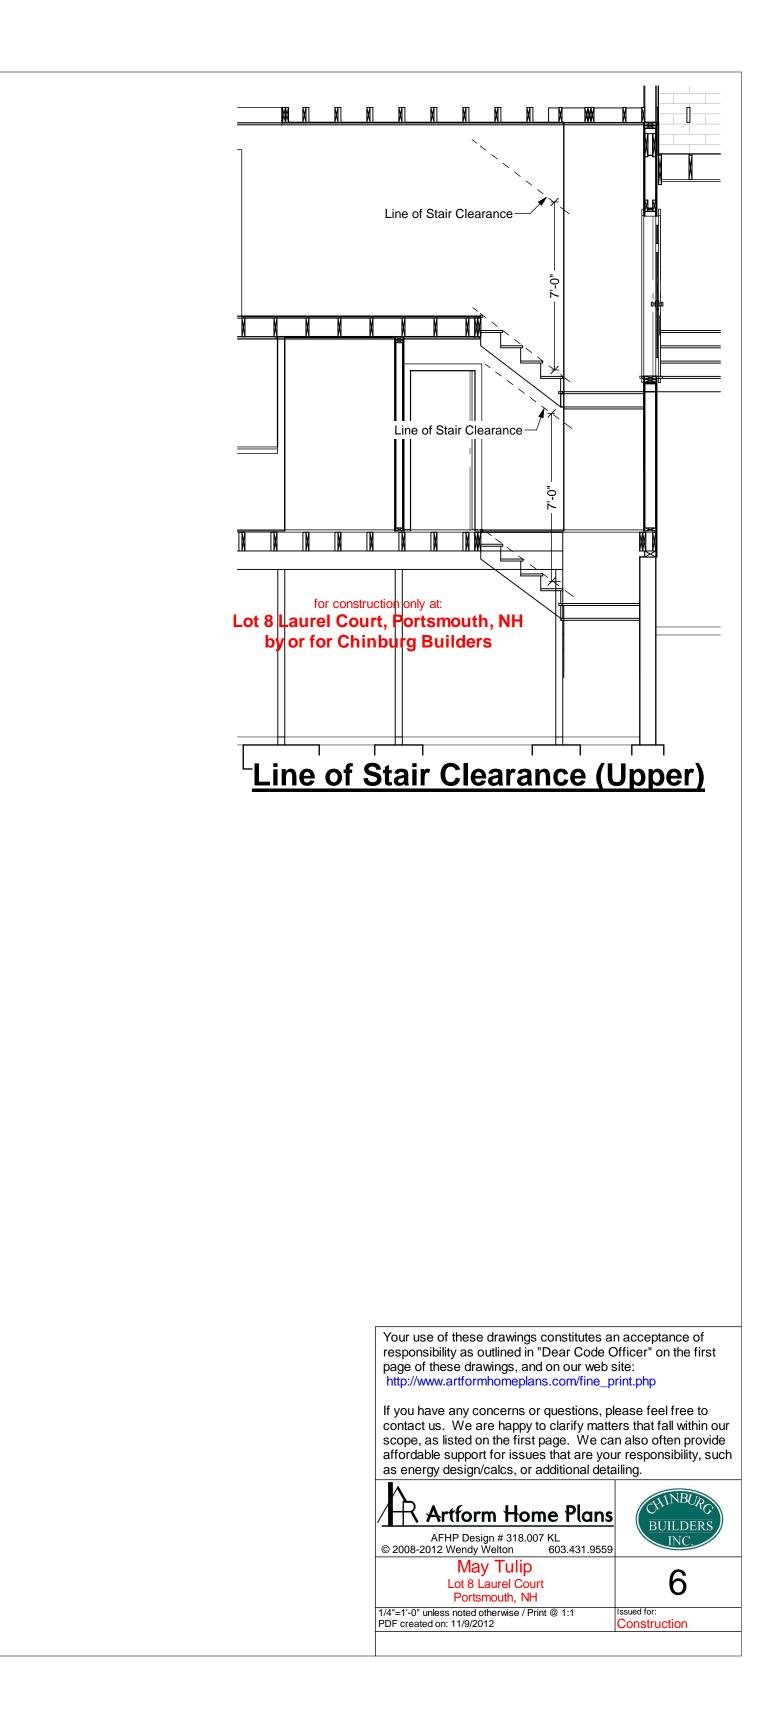

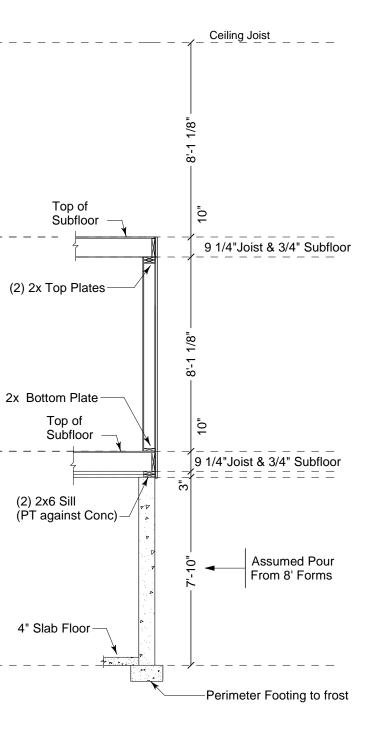



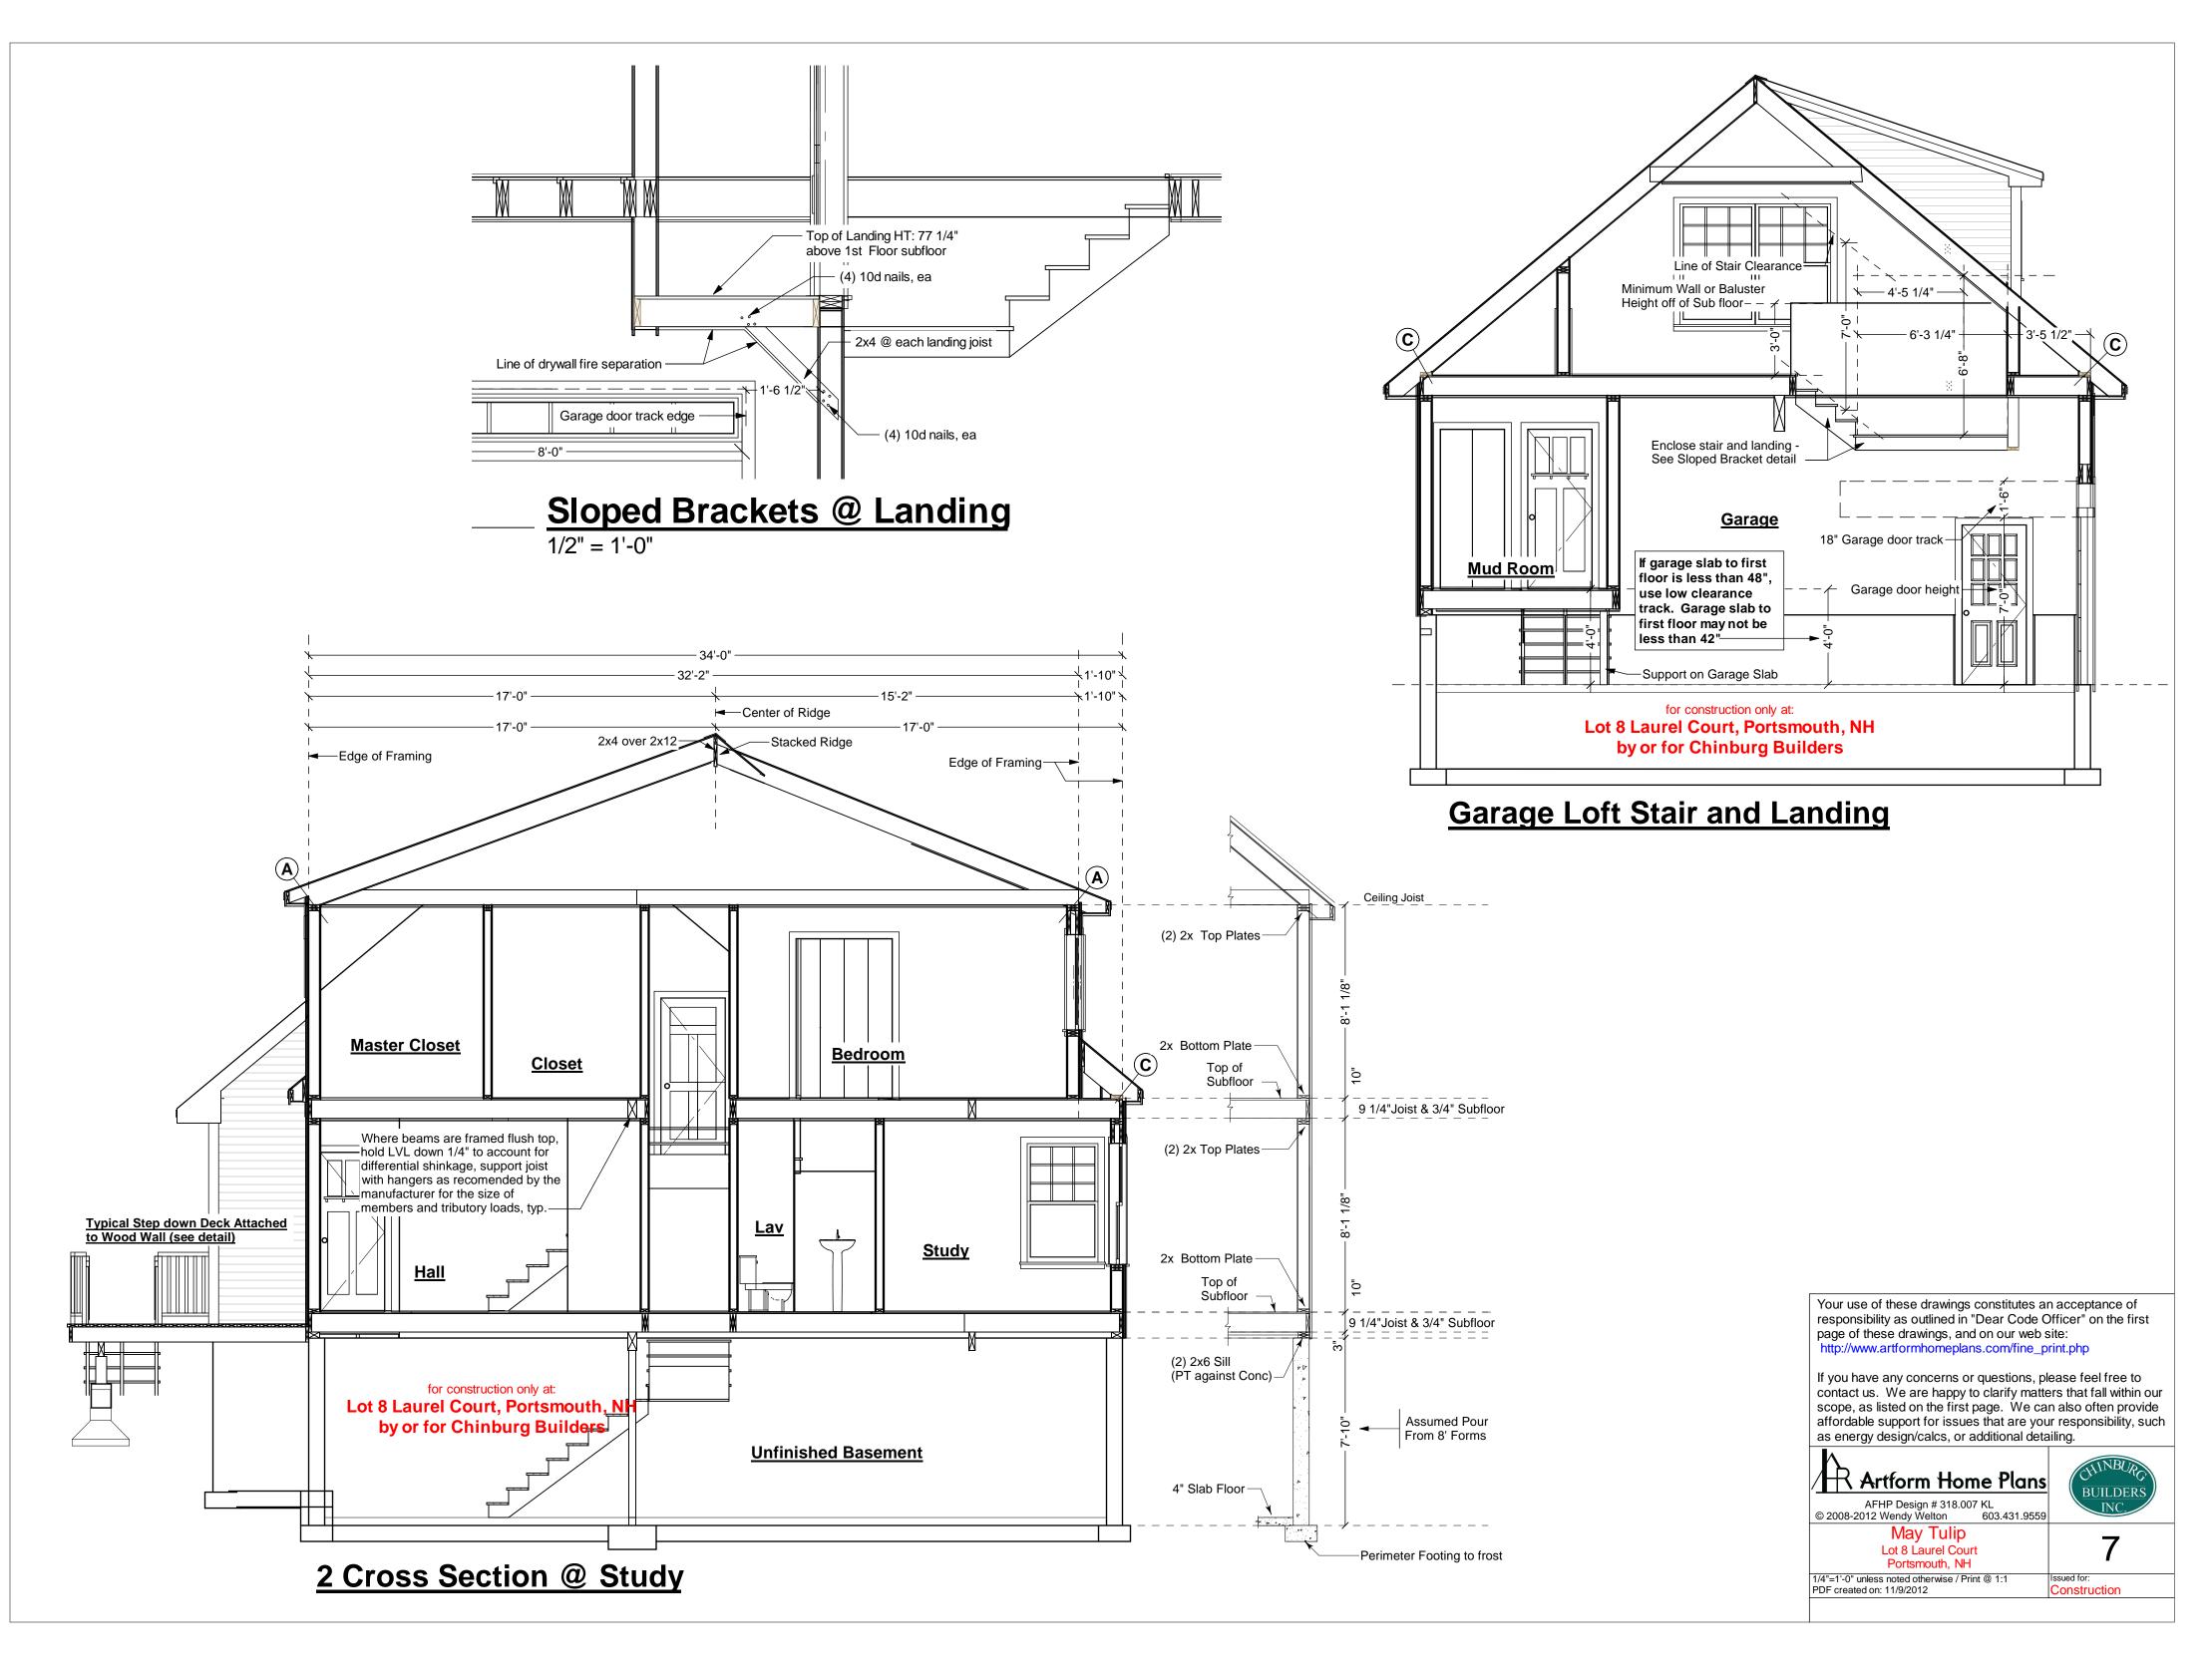


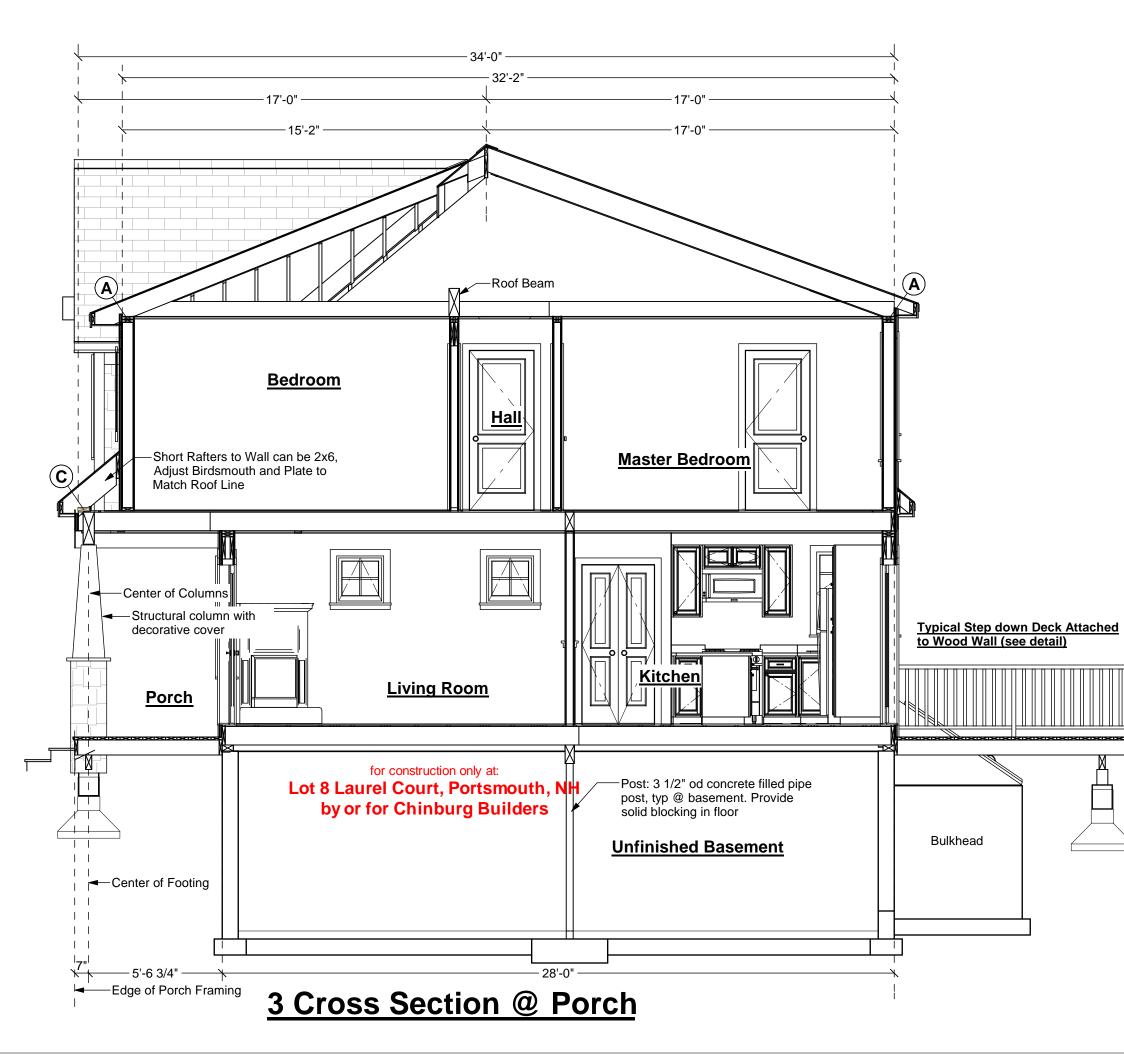


12:01:00 PM 11/9/2012

CD 318.007 KL 370 api Only - No GA Fr Do т 2 May 318\318.007 May ulip, :\AFAS


Š

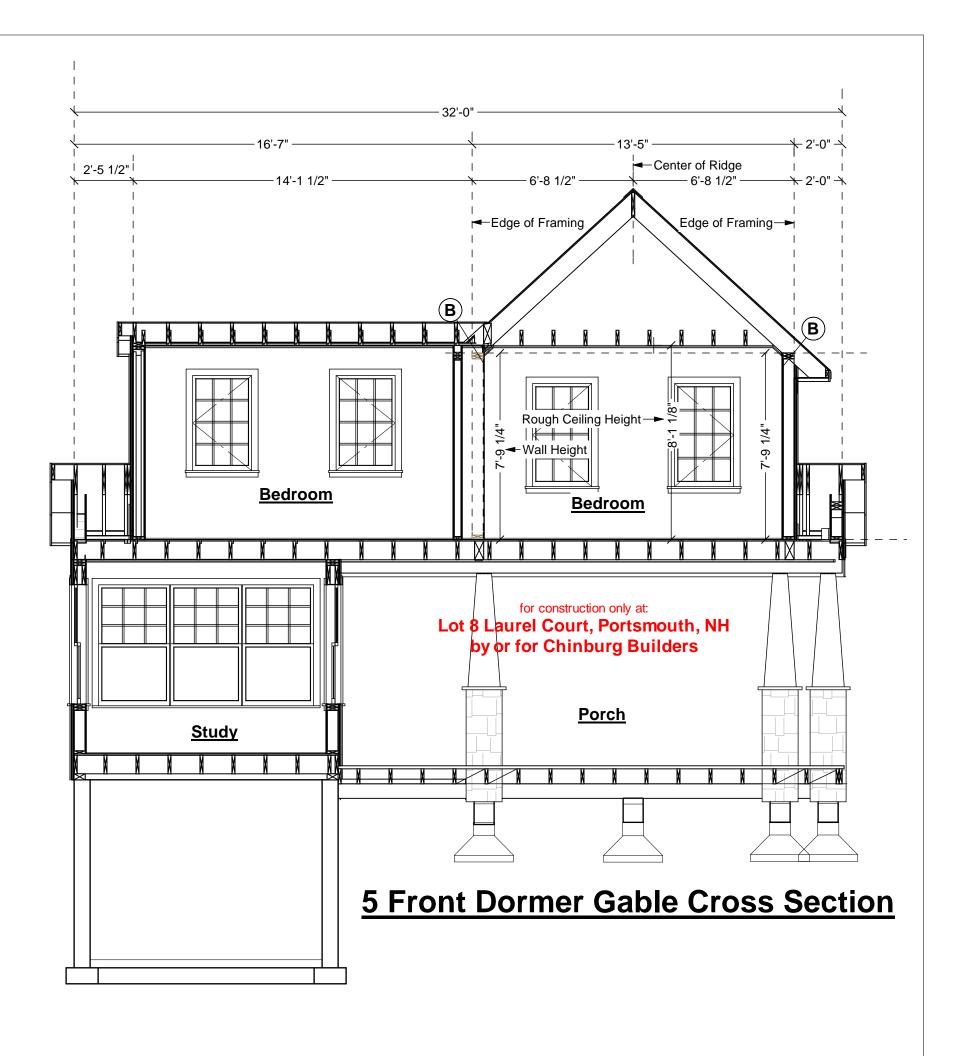




Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	DIINBURG BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	8
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

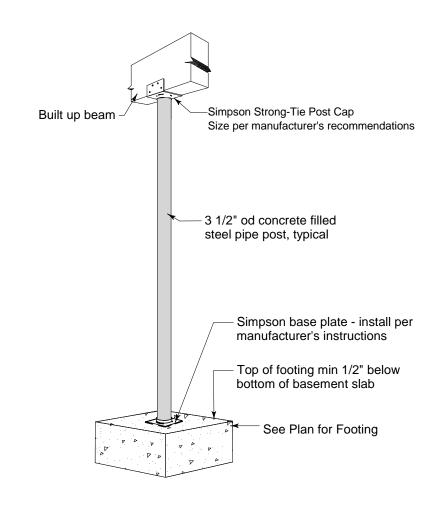


# Typical Basement Post

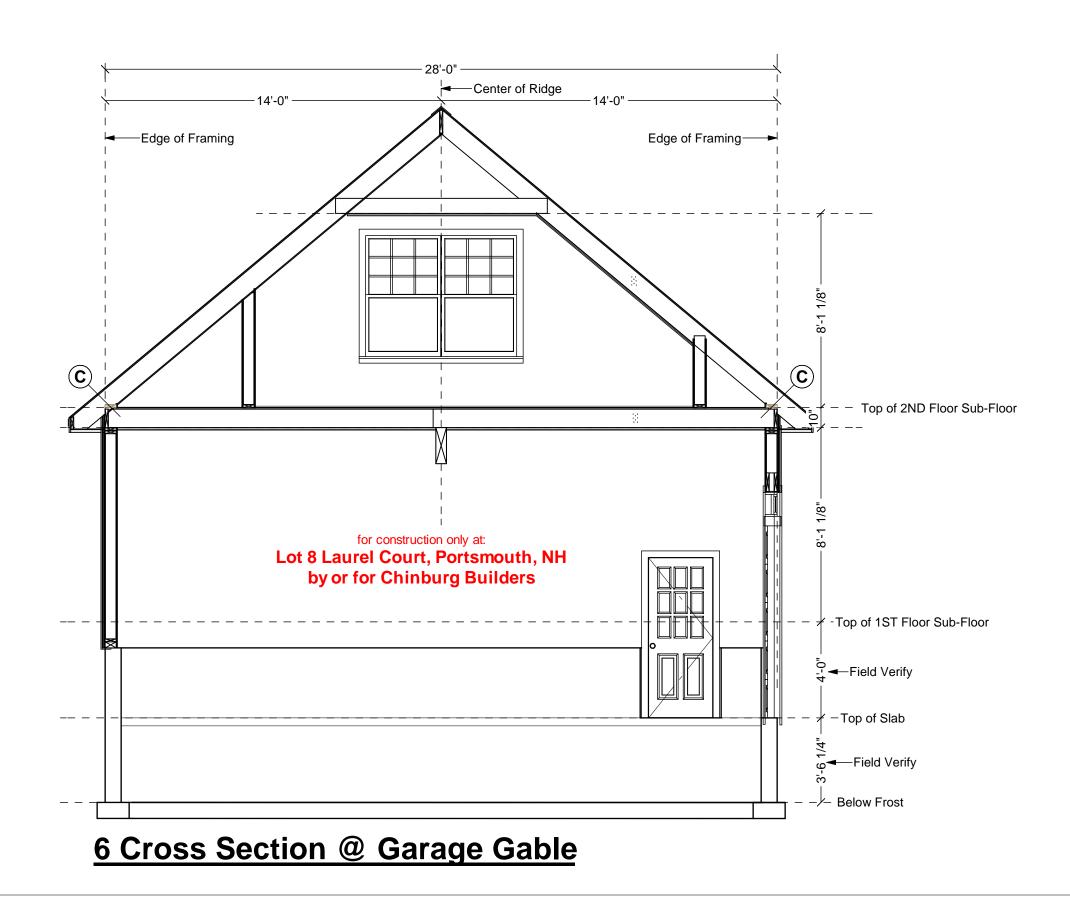


11/9/2012 12:01:00 PM


 $\geq$ 

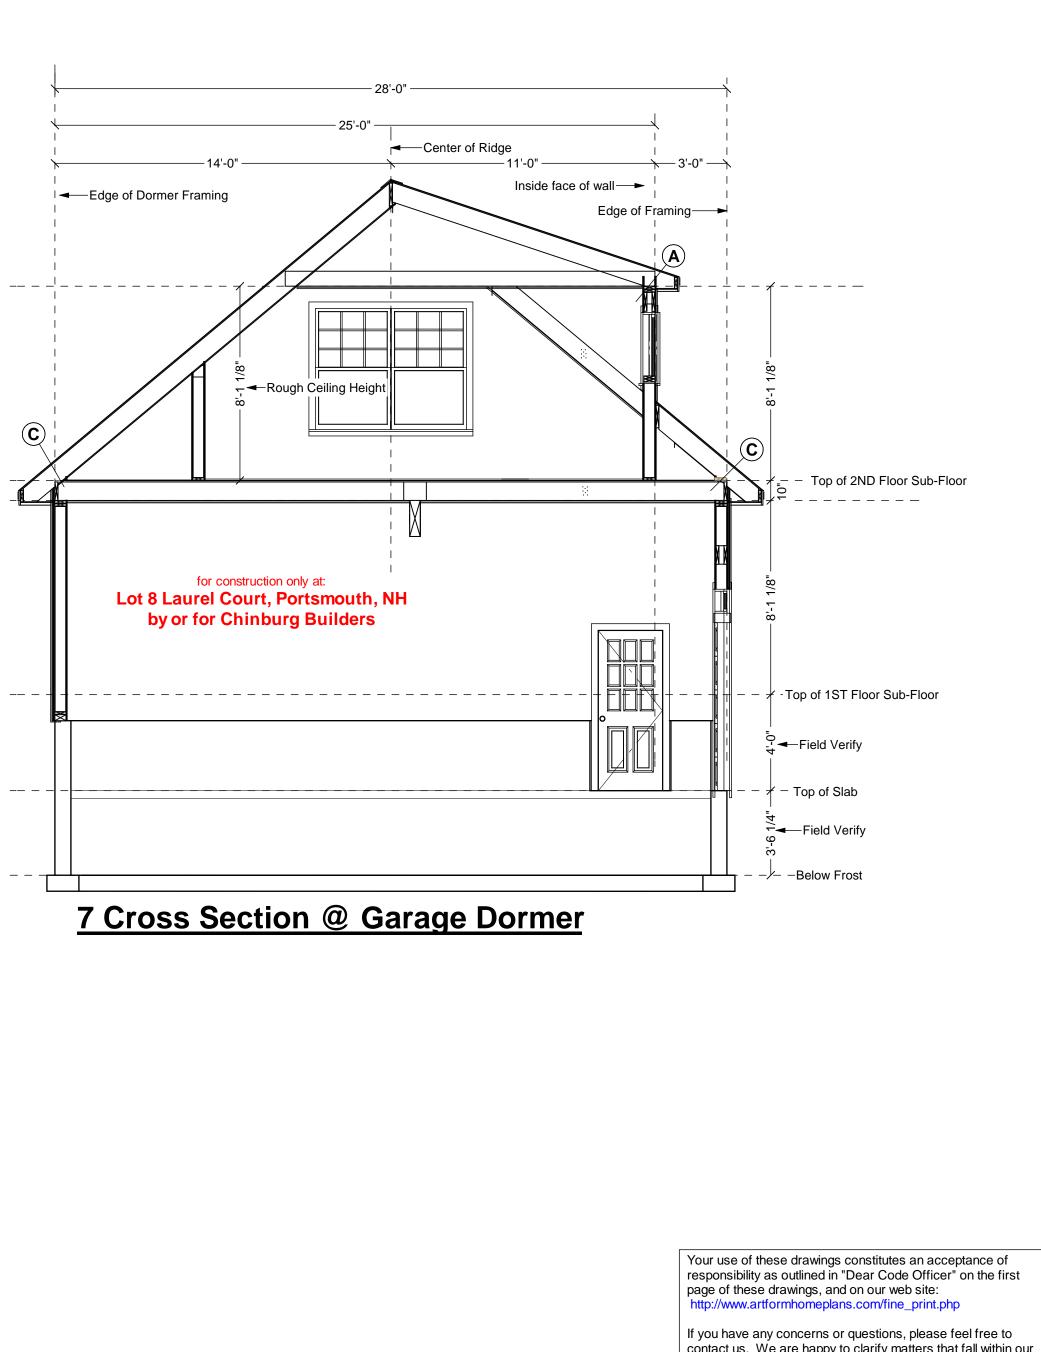


contact us. We are happy to clarify matters that fall within our scope, as listed on the first page. We can also often provide affordable support for issues that are your responsibility, such as energy design/calcs, or additional detailing.

AFHP Design # 318.007 KL	BUILDERS
© 2008-2012 Wendy Welton 603.431.9559	INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	9
1/4"=1'-0" unless noted otherwise / Print @ 1:1	Issued for:
PDF created on: 11/9/2012	Construction



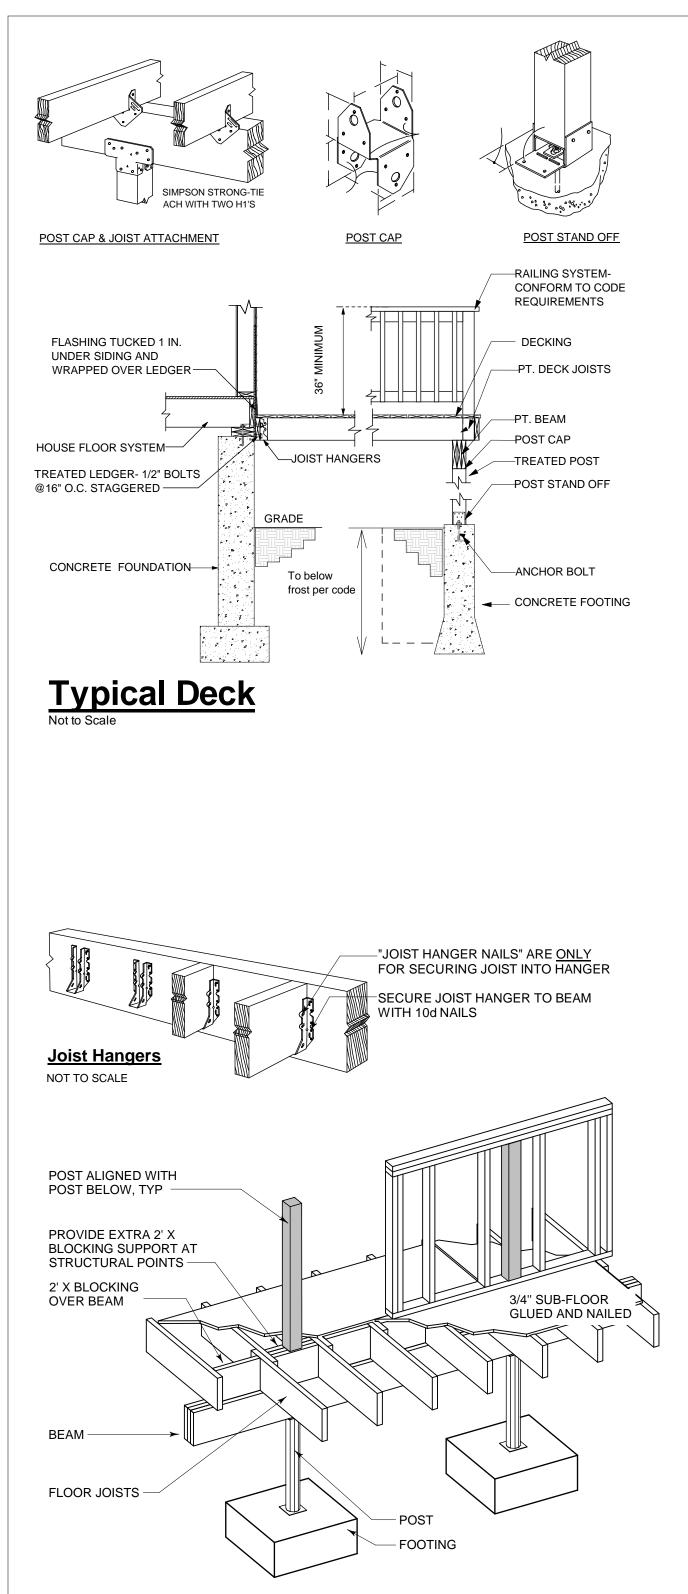

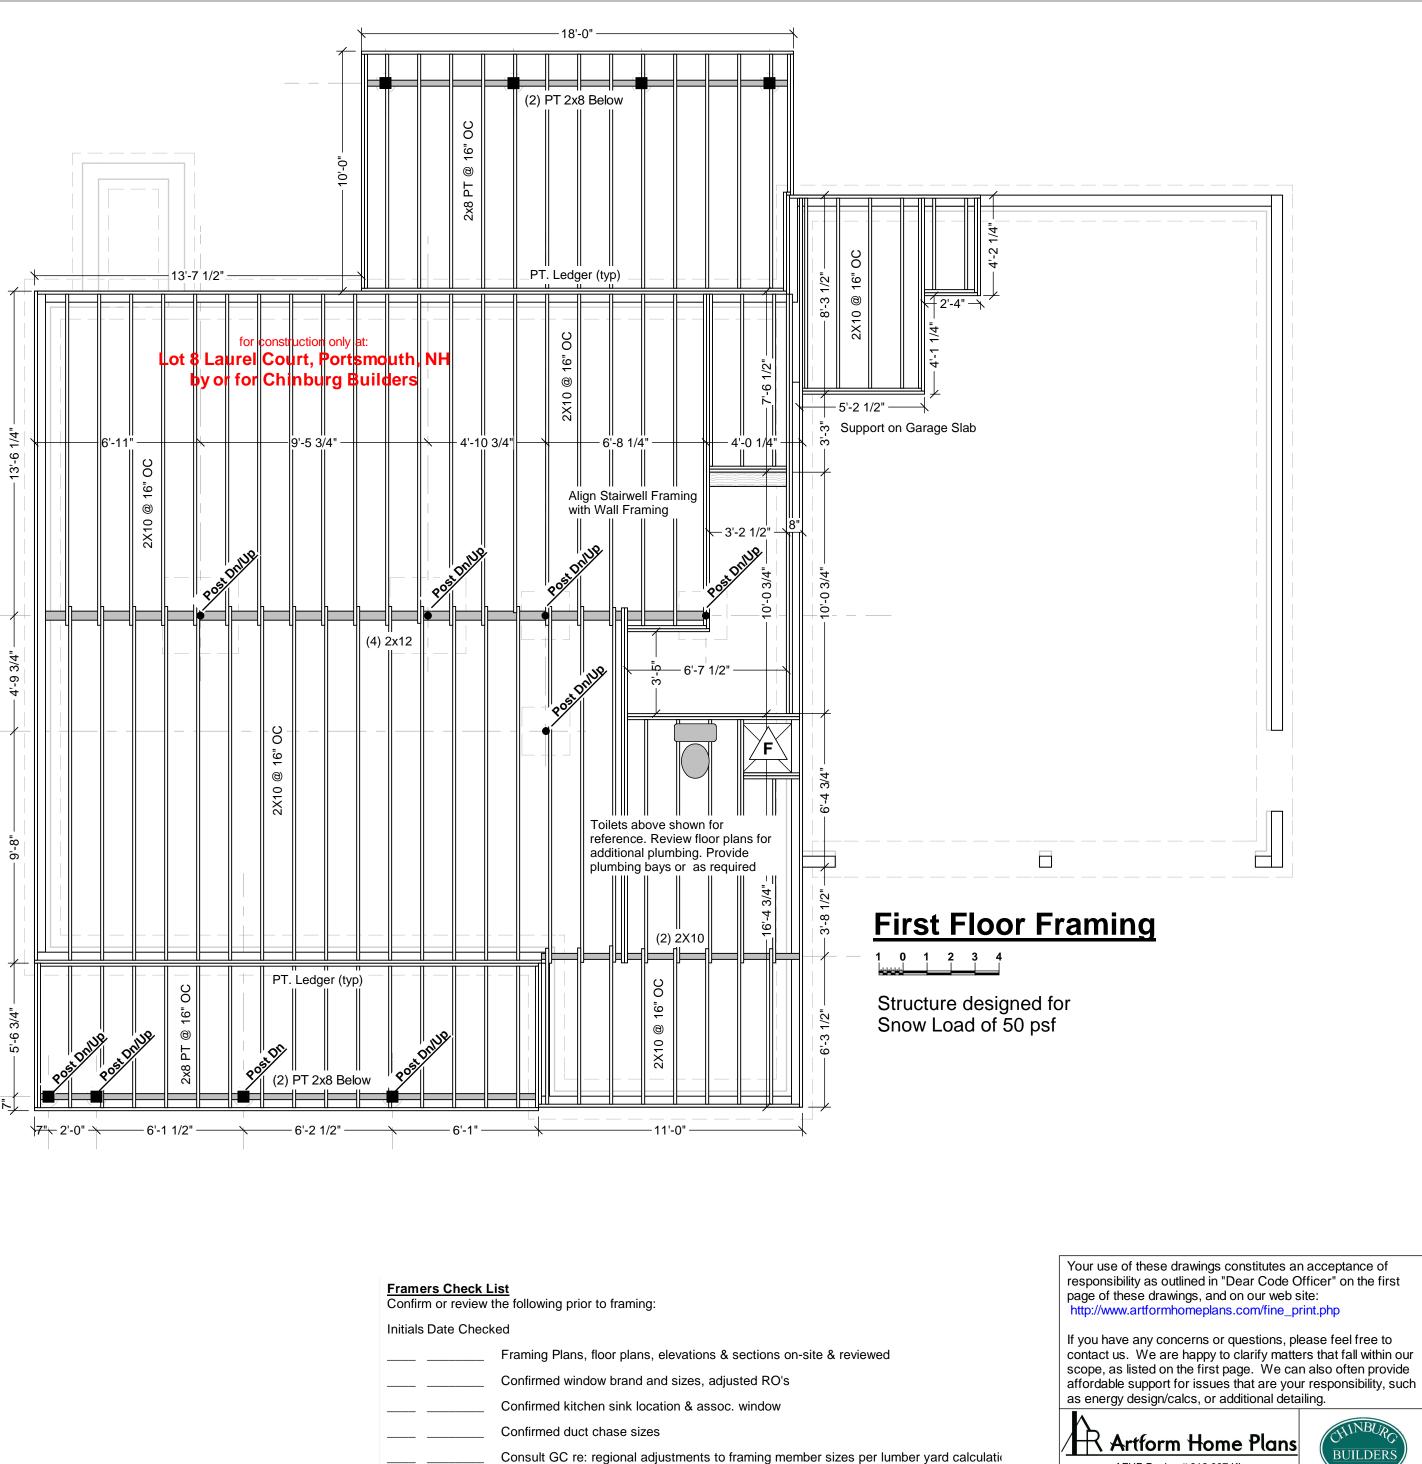


 If rafter	size changed to accommoda	ate snow load different	, reviewed details,	particularly
where	windows near roofs, for nee	ded adjustments		

\_ \_\_\_\_ Confirmed optional porch and/or deck sizes

\_\_\_\_\_

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	UHINBURG BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	10
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

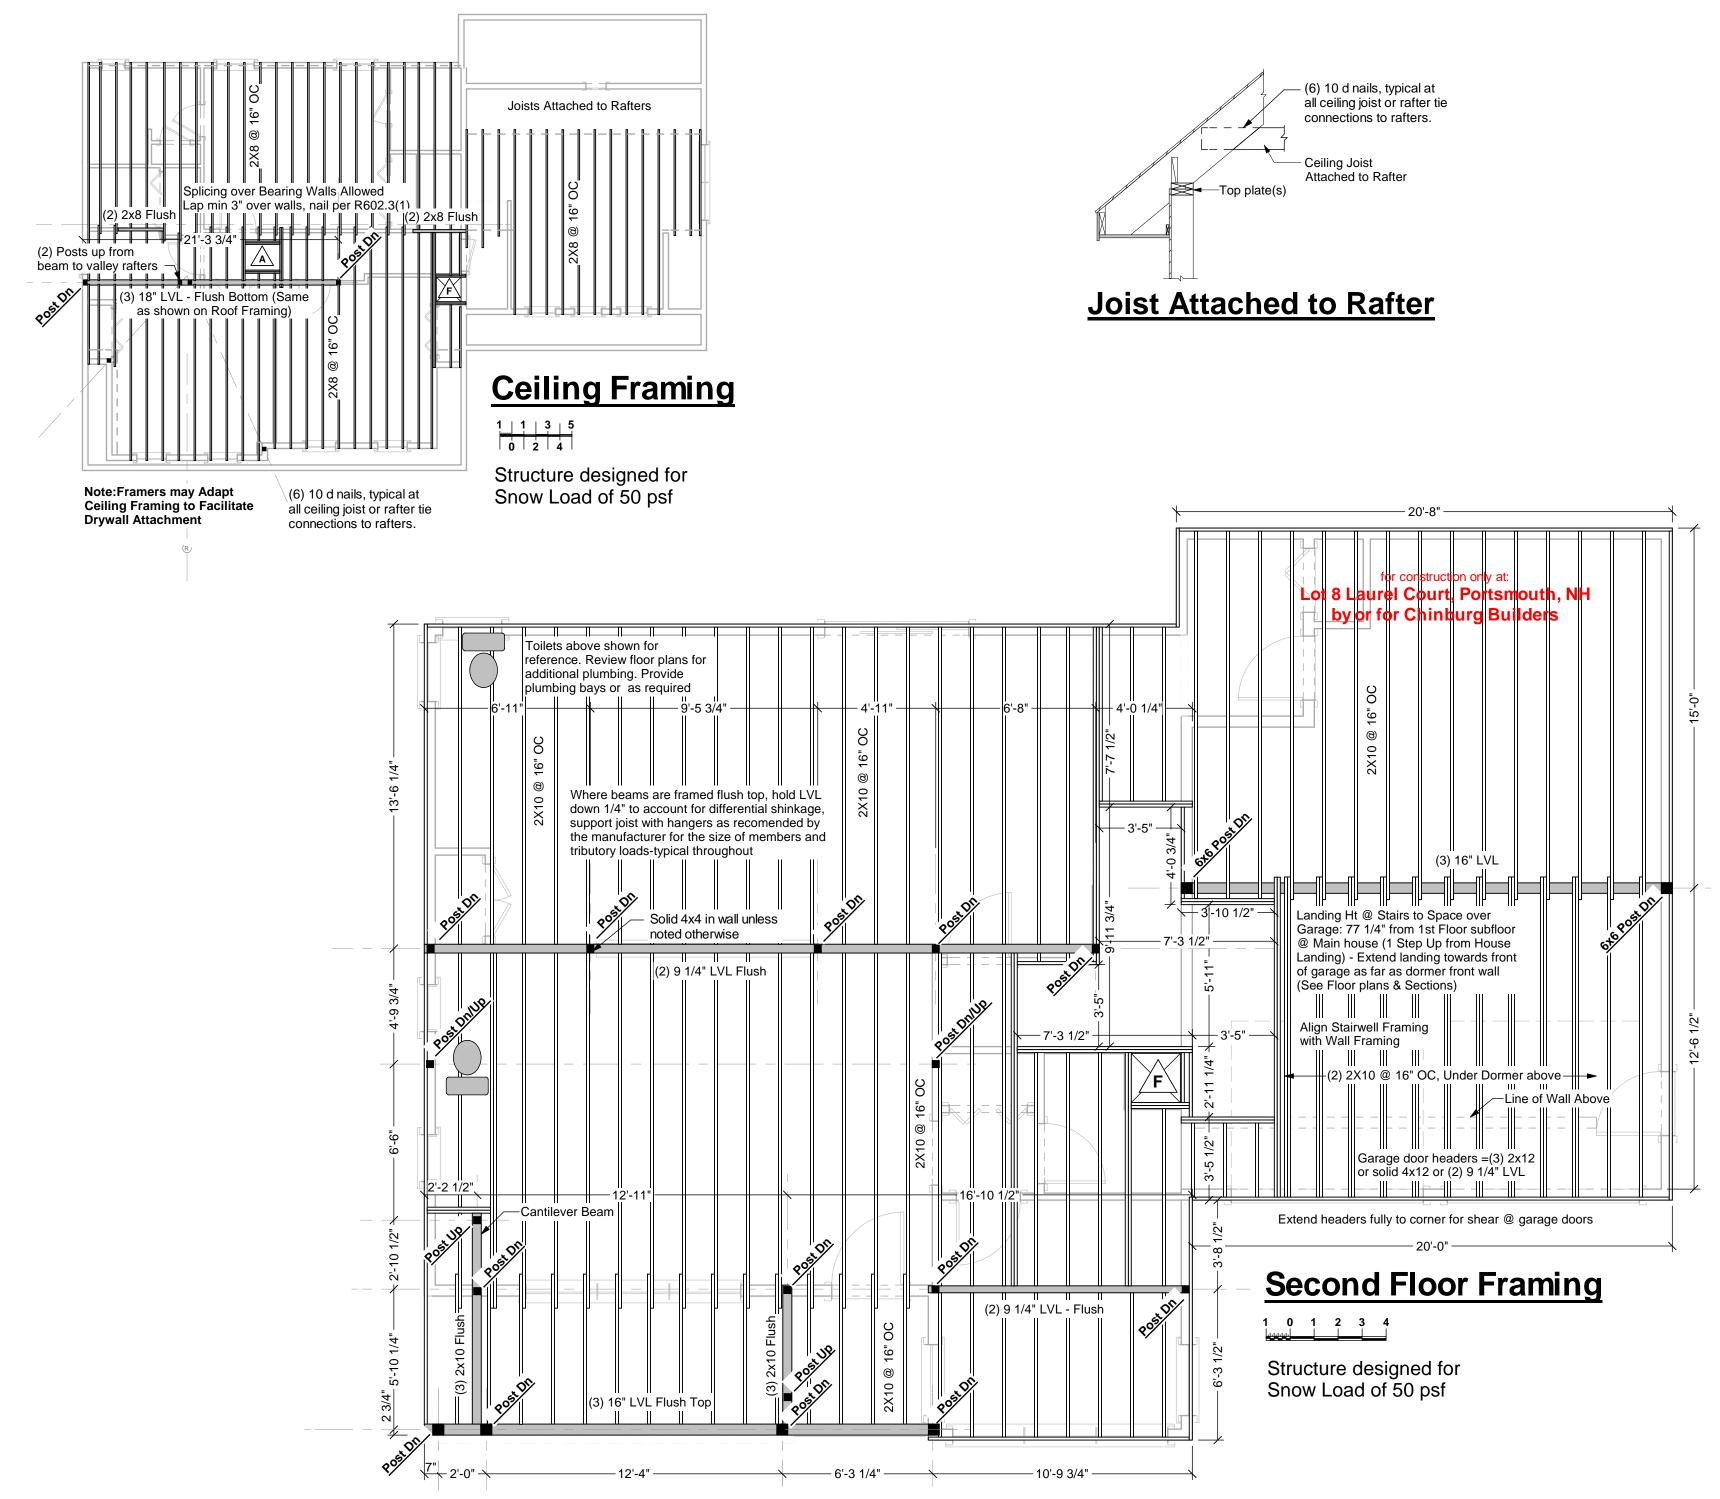

12:01:04 PM 11/9/2012

370 Ţ 007 318. G ō ц БA ц May .007 3/3,

### Built-up Beams:

Unless otherwise noted, connect multiple ply beams as follows:

### (2) 9 1/4" LVL:

- · Flush framed
  - o (2) rows 3 3/8" TrussLock @ 24" oc, or ○ (2) rows SDS 1/4x3 1/2 @ 24" oc
- Framed under (2) rows 10d nails @ 24" oc (2) 11 1/4" LVL

### • Flush framed

- o (2) rows 3 3/8" TrussLock @ 19.2" oc, or ○ (2) rows SDS 1/4x3 1/2 @ 19.2" oc
- Framed under (2) rows 10d nails @ 24" oc

### (2) 16" LVL or greater: Flush framed

- (3) rows 3 3/8" TrussLock @ 19.2" oc, or ○ (3) rows SDS 1/4x3 1/2 @ 19.2" oc
- Framed under (2) rows 10d nails @ 24" oc

### (3) 9 1/4" LVL: · Flush framed

- o (2) rows 3 3/8" TrussLock @ 19.2" oc, or ○ (2) rows SDS 1/4x3 1/2 @ 19.2" oc
- Framed under (2) rows 10d nails @ 24" oc

### (3) 11 1/4" LVL

- Flush framed ○ (2) rows 3 3/8" TrussLock @ 16" oc, or ○ (2) rows SDS 1/4x3 1/2 @ 16" oc
- Framed under (2) rows 10d nails @ 24" oc

### (3) 16" LVL or greater:

- Flush framed ○ (3) rows 3 3/8" TrussLock @ 16" oc, or
- (3) rows SDS 1/4x3 1/2 @ 16" oc • Framed under – (2) rows 10d nails @ 24" oc

### (4) 9 1/4" LVL:

- Flush framed ○ (2) rows 5" TrussLock @ 16" oc, or
- (2) rows SDS 1/4x6 @ 16" oc
- Framed under (2) rows 10d nails @ 24" oc (4) 11 1/4" LVL:

### • Flush framed

- (2) rows 5" TrussLock @ 16" oc, or
- (2) rows SDS 1/4x6 @ 16" oc
- Framed under (2) rows 10d nails @ 12" oc

### (4) 16" LVL or greater:

### Flush framed

- (3) rows 5" TrussLock @ 16" oc, or ○ (3) rows SDS 1/4x6 @ 16" oc
- Framed under (2) rows 10d nails @ 12" oc

### Beam Substitutions:

(2) 9 1/4" LVL may replace a double or triple 2x10 beam. No other substitutions are allowed. Conventional lumber beams MAY NOT be substituted for LVL beams by any "rule of thumb". Substitutions must be calculated by either Artform or a structural engineer. If calculated by a structural engineer, provide stamped plans and/or calculations.


We specify LVL beams as built up members to allow framers to use existing stock. You may substitute single piece LVLs of equivalent overall size for built-up members, unless otherwise noted.

Built-up members MAY NOT replace single piece LVL's where specified.


Where a beam of 1 3/4" or less in width is specified as framed under, either brace at 48" or double member for lateral stability.

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	UTINBURG BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	11
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction

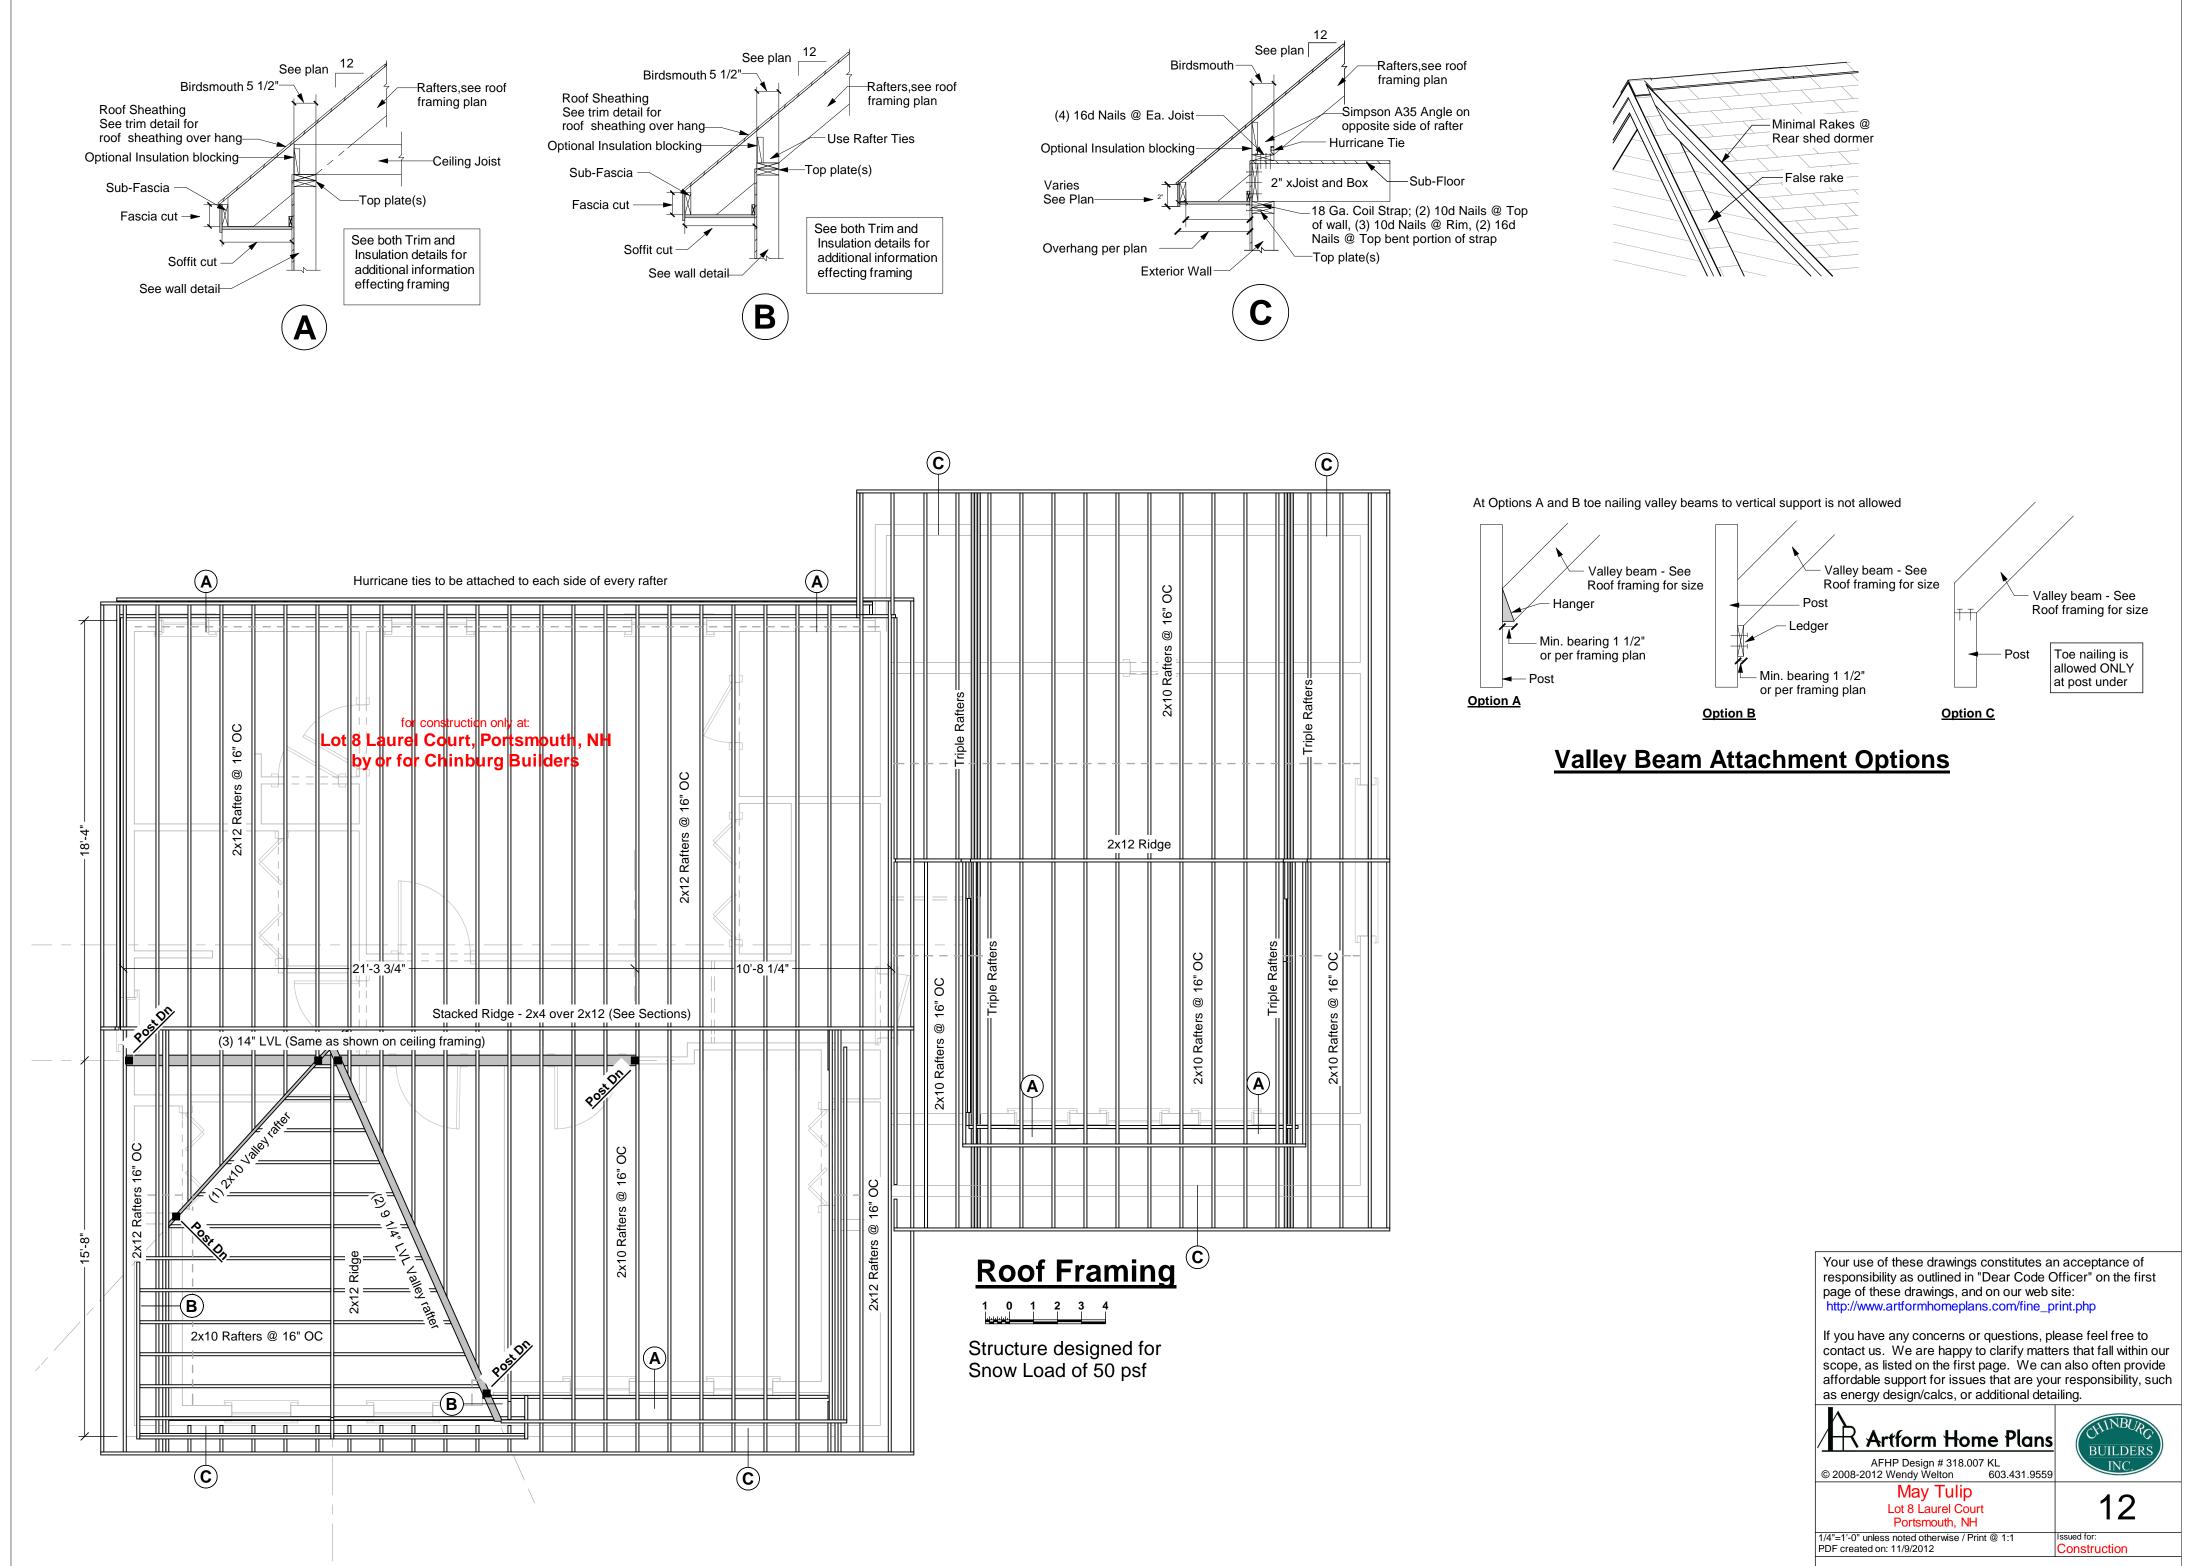

≥

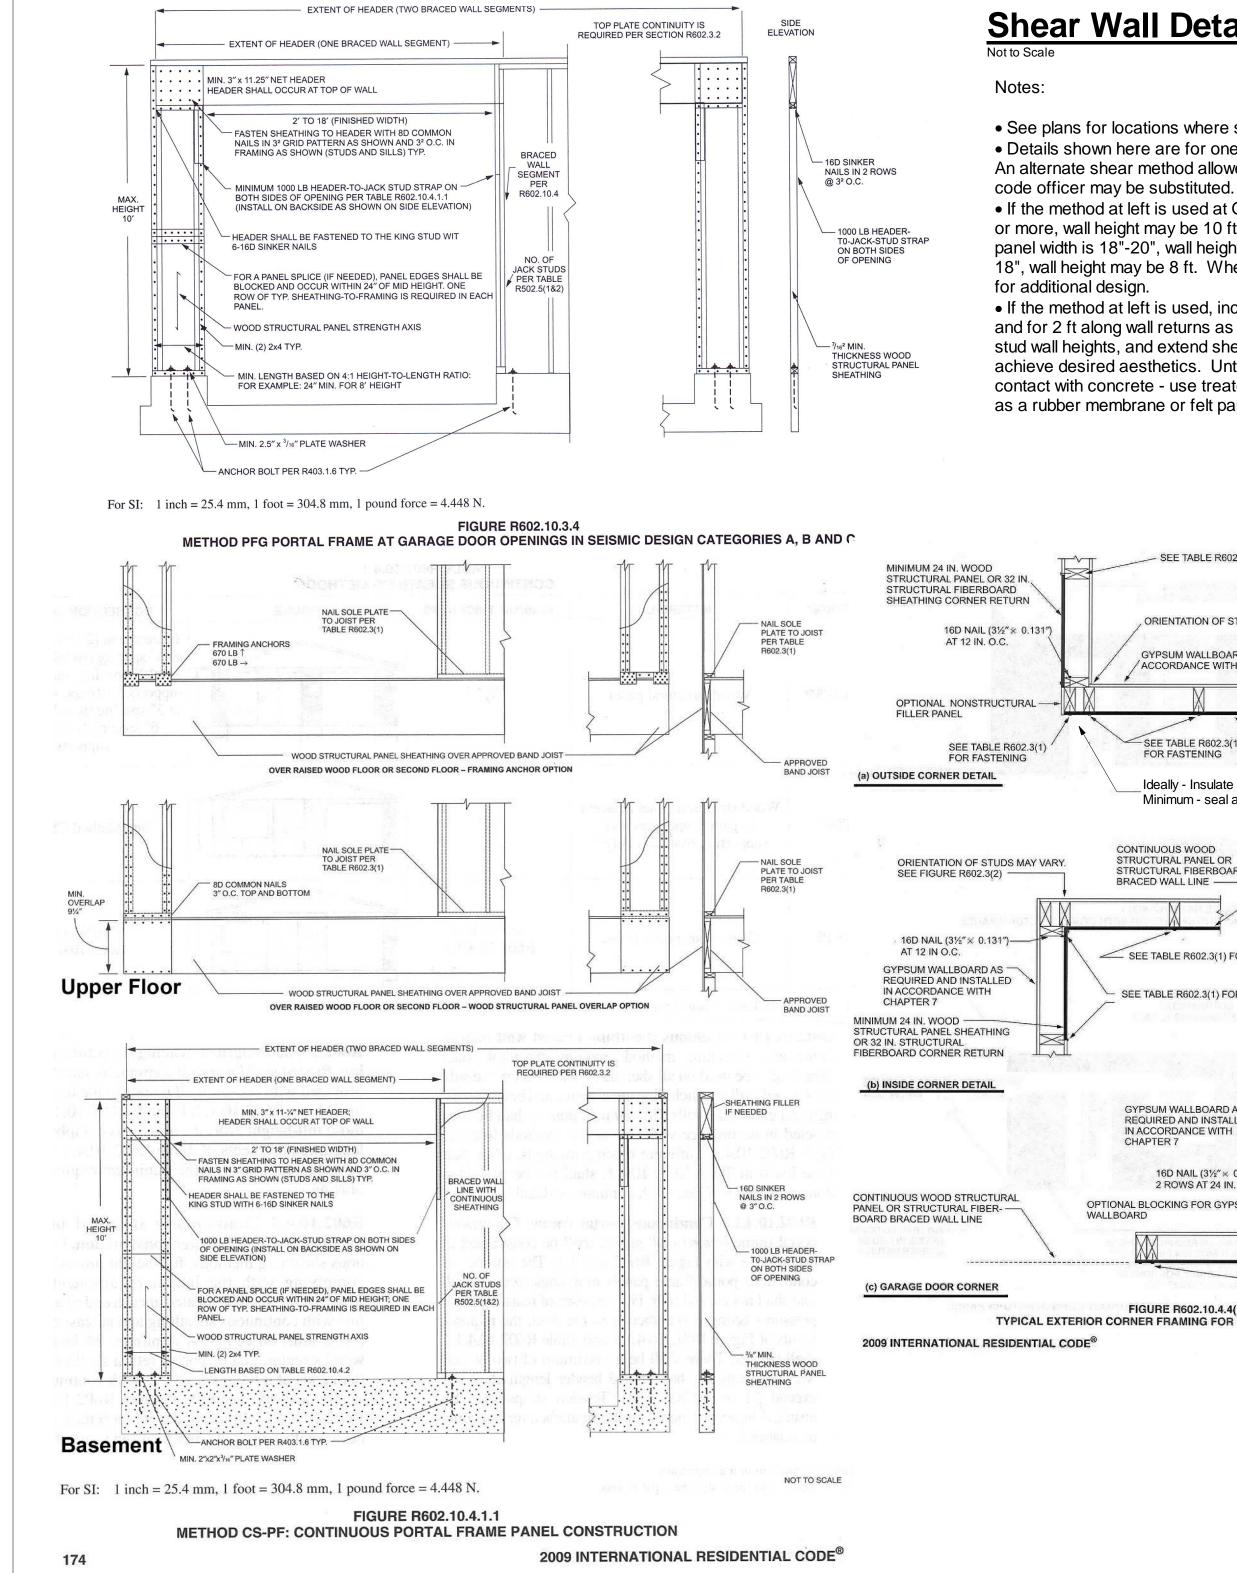

12:01:04 PM 2 /201

370 국 007 318. 0 цĒ Ч Π. 007 8/3

## **Shear Wall Details**

 See plans for locations where shear panels are required. • Details shown here are for one method and for typical conditions. An alternate shear method allowed per code or approved by the

• If the method at left is used at Garages where width of panel is 20" or more, wall height may be 10 ft as shown in detail at left. Where panel width is 18"-20", wall height may be 9 ft. Where panel is 16"-18", wall height may be 8 ft. Where panel is less, consult architect

• If the method at left is used, increase foundation wall height at front and for 2 ft along wall returns as required to meet maximum wood stud wall heights, and extend sheathing and siding in front of wall to achieve desired aesthetics. Untreaded wood may not be in direct contact with concrete - use treated wood or provide a barrier, such as a rubber membrane or felt paper.

SEE TABLE R602.3(1) FOR FASTENING

ORIENTATION OF STUD MAY VARY SEE FIGURE R602.3(2)

GYPSUM WALLBOARD AS REQUIRED AND INSTALLED IN **ACCORDANCE WITH CHAPTER 7** 

SEE TABLE R602.3(1)

CONTINUOUS WOOD STRUCTURAL PANEL BRACED WALL LINE FOR FASTENING

Ideally - Insulate corner prior to sheathing. Minimum - seal all wood joints prior to sheathing.

CONTINUOUS WOOD STRUCTURAL PANEL OR STRUCTURAL FIBERBOARD

BRACED WALL LINE

SEE TABLE R602.3(1) FOR FASTENING

SEE TABLE R602.3(1) FOR FASTENING

GYPSUM WALLBOARD AS REQUIRED AND INSTALLED IN ACCORDANCE WITH CHAPTER 7 16D NAIL (31/2"× 0.131") 2 ROWS AT 24 IN. O.C. OPTIONAL BLOCKING FOR GYPSUM -WALLBOARD  $\sim$  SEE TABLE R602.3(1) FOR FASTENING

MINIMUM 24 IN. WOOD STRUCTURAL PANEL SHEATHING OR 32 IN. STRUCTURAL FIBERBOARD SHEATHING (BOTH EDGES AT CORNERS)

SEE TABLE R 602.3(1) FOR FASTENING

OPTIONAL NONSTRUCTURAL FILLER PANEL


FASTENERS ON BOTH STUDS AT EACH PANEL EDGE


FIGURE R602.10.4.4(1) TYPICAL EXTERIOR CORNER FRAMING FOR CONTINUOUS SHEATHING

177

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	CHINBURC BUILDERS INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	13
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction



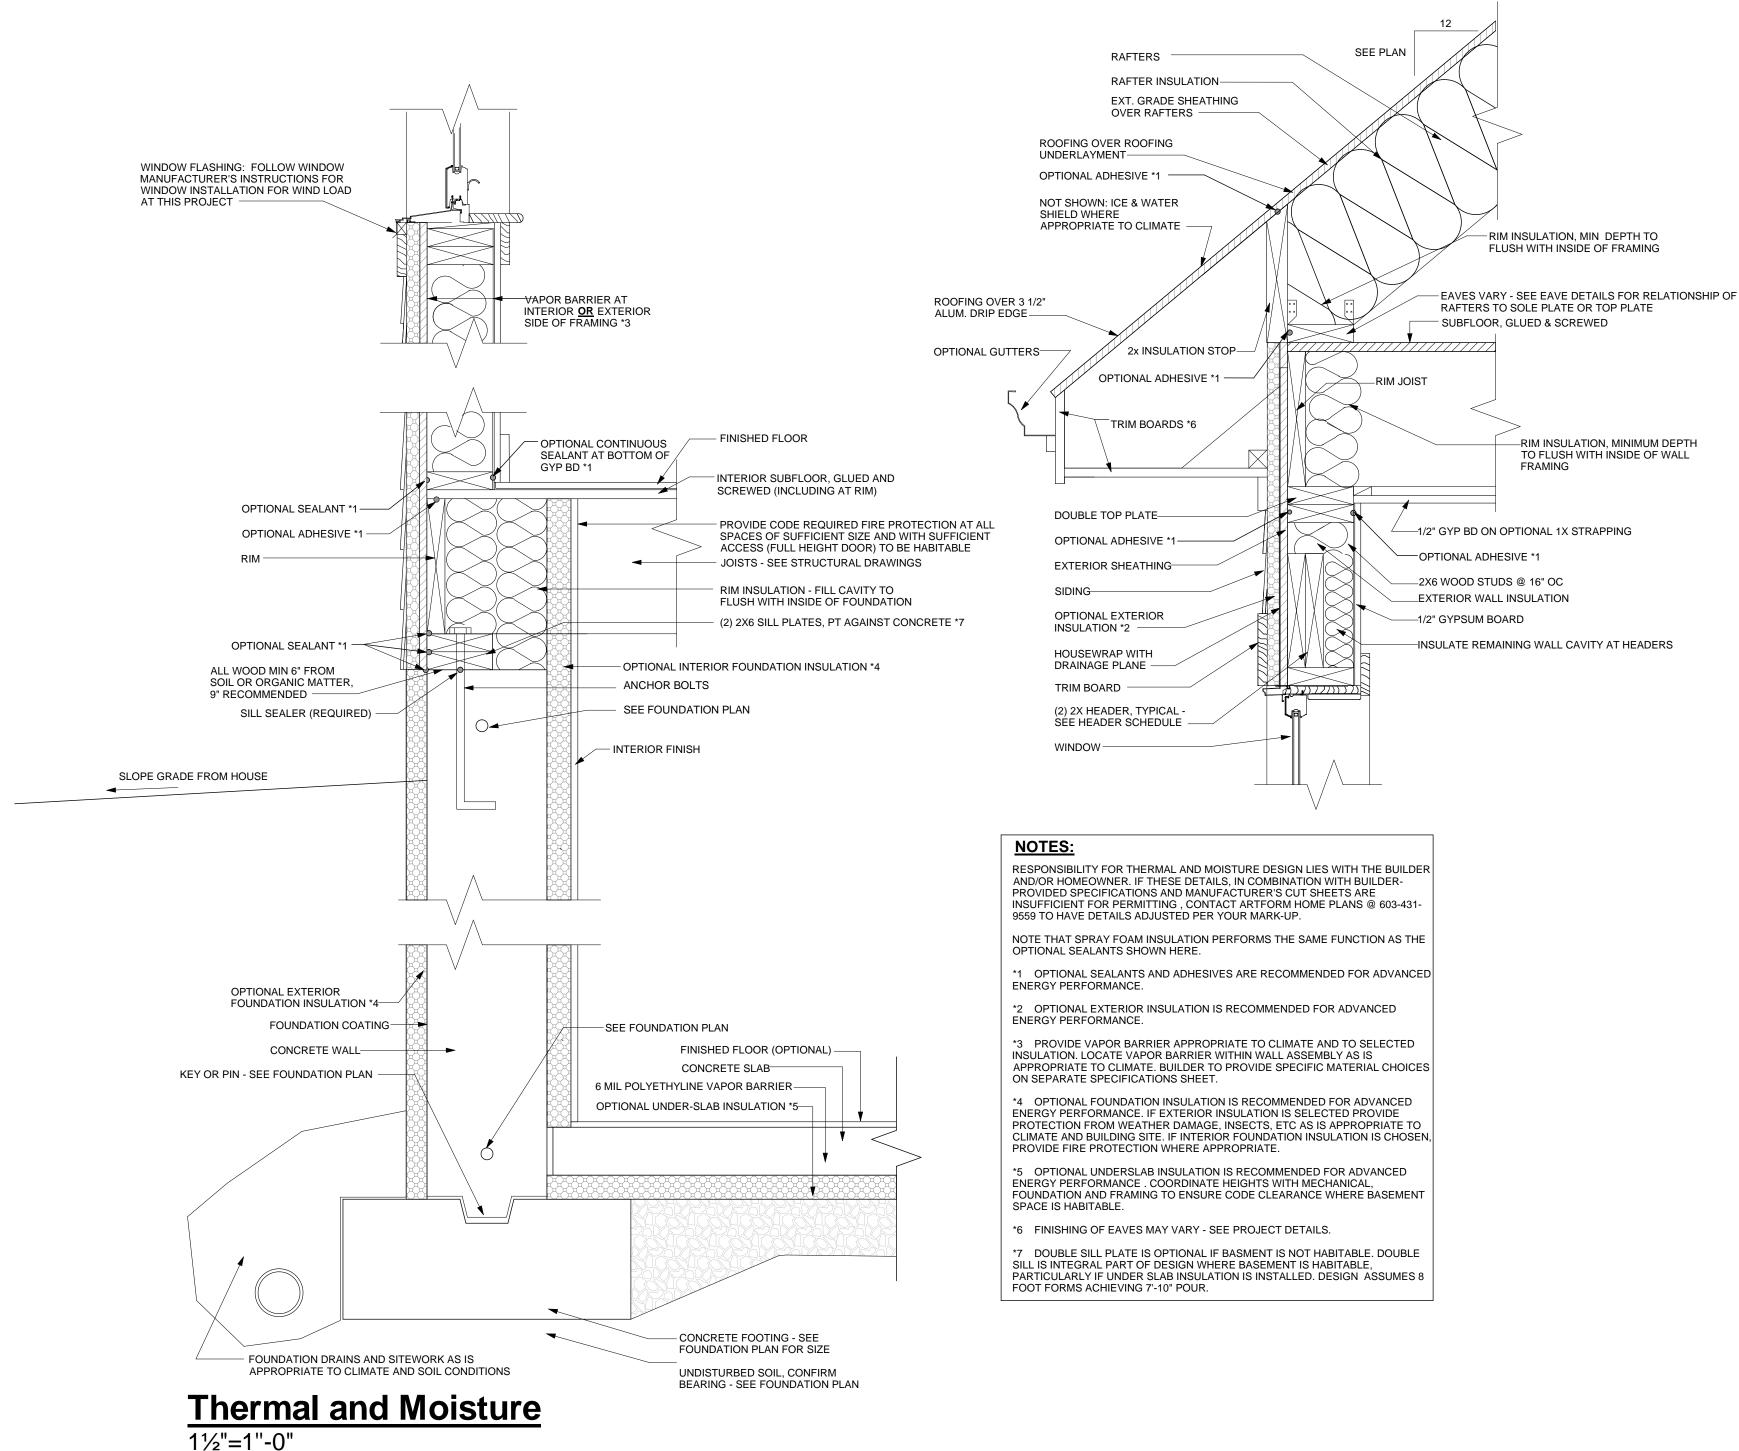

Your use of these drawings constitutes an acceptance of responsibility as outlined in "Dear Code Officer" on the first page of these drawings, and on our web site: http://www.artformhomeplans.com/fine\_print.php

Artform Home Plans	CHINBURG BUILDERS
AFHP Design # 318.007 KL © 2008-2012 Wendy Welton 603.431.9559	INC.
May Tulip Lot 8 Laurel Court Portsmouth, NH	TM 1
1/4"=1'-0" unless noted otherwise / Print @ 1:1 PDF created on: 11/9/2012	Issued for: Construction